




SNP: A -> C Calibration

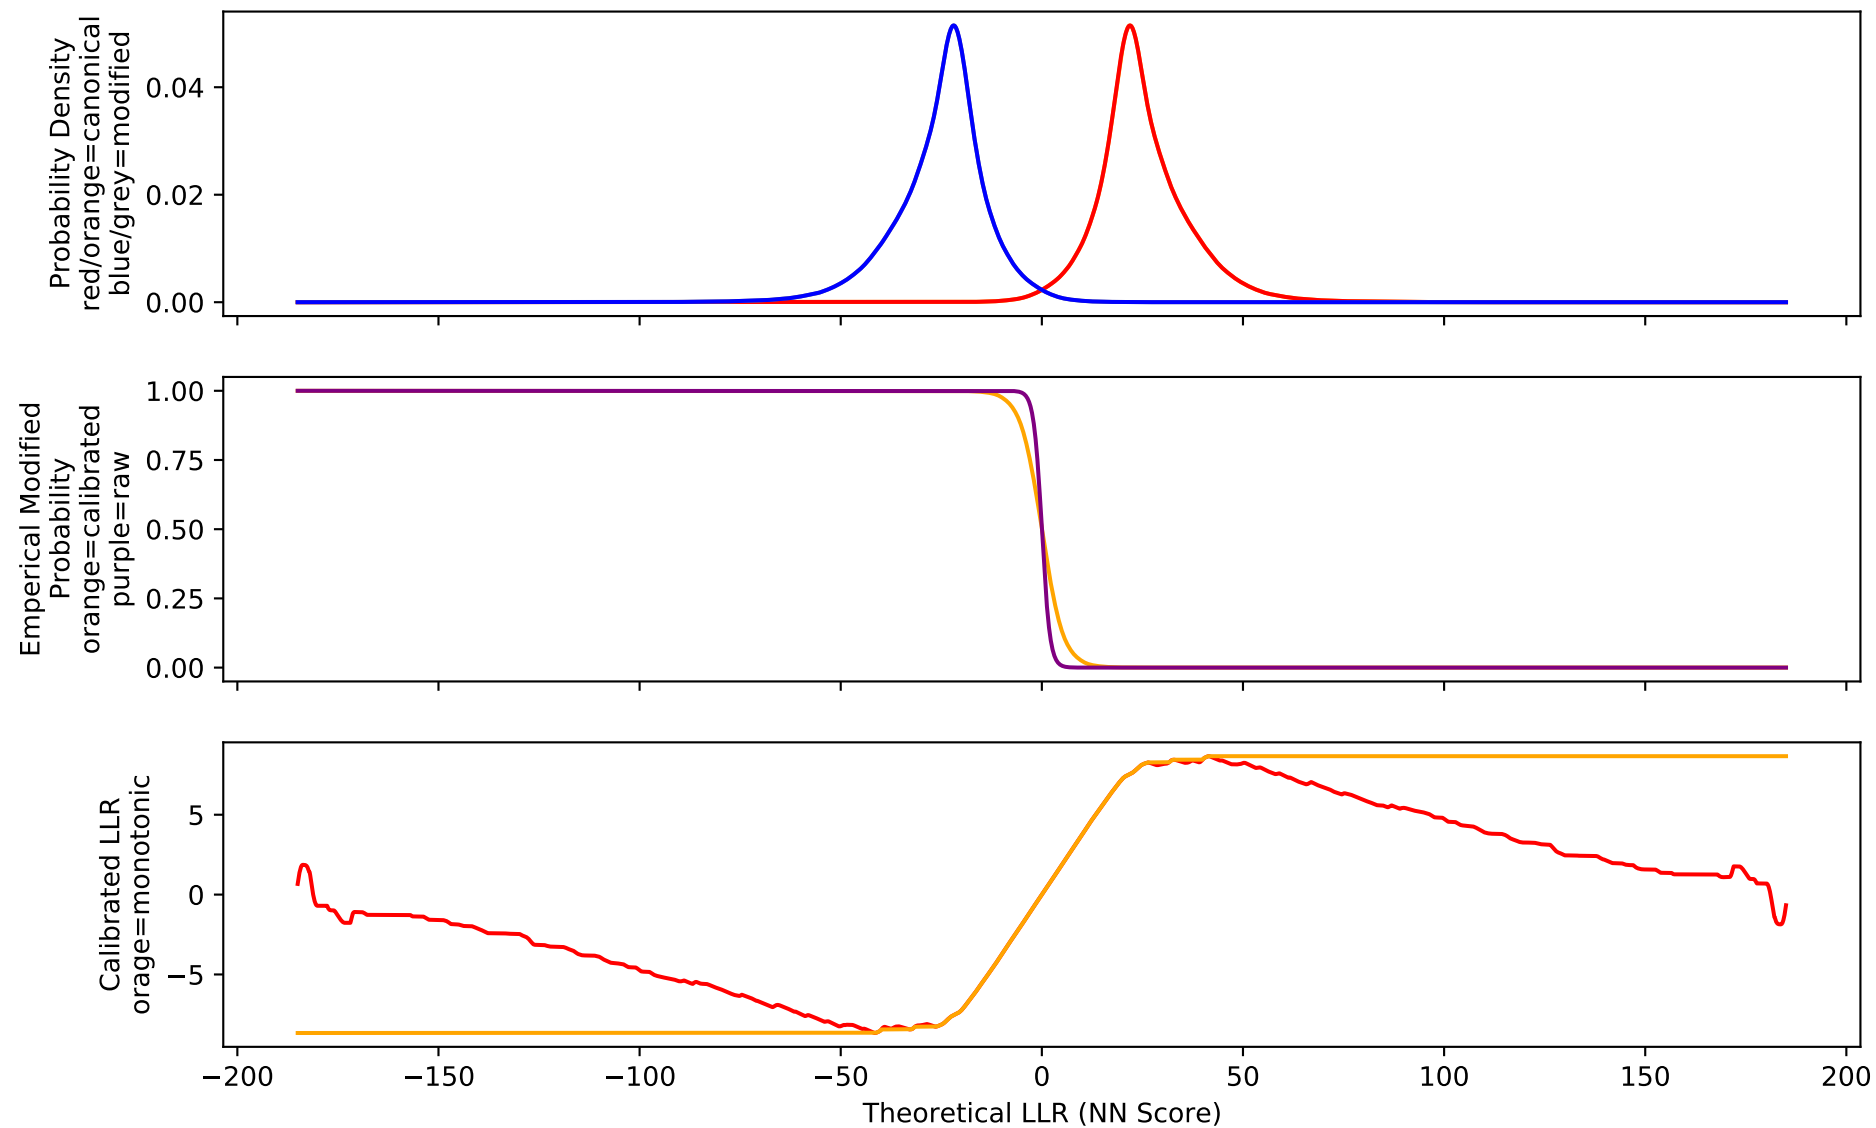


SNP: A -> G Calibration

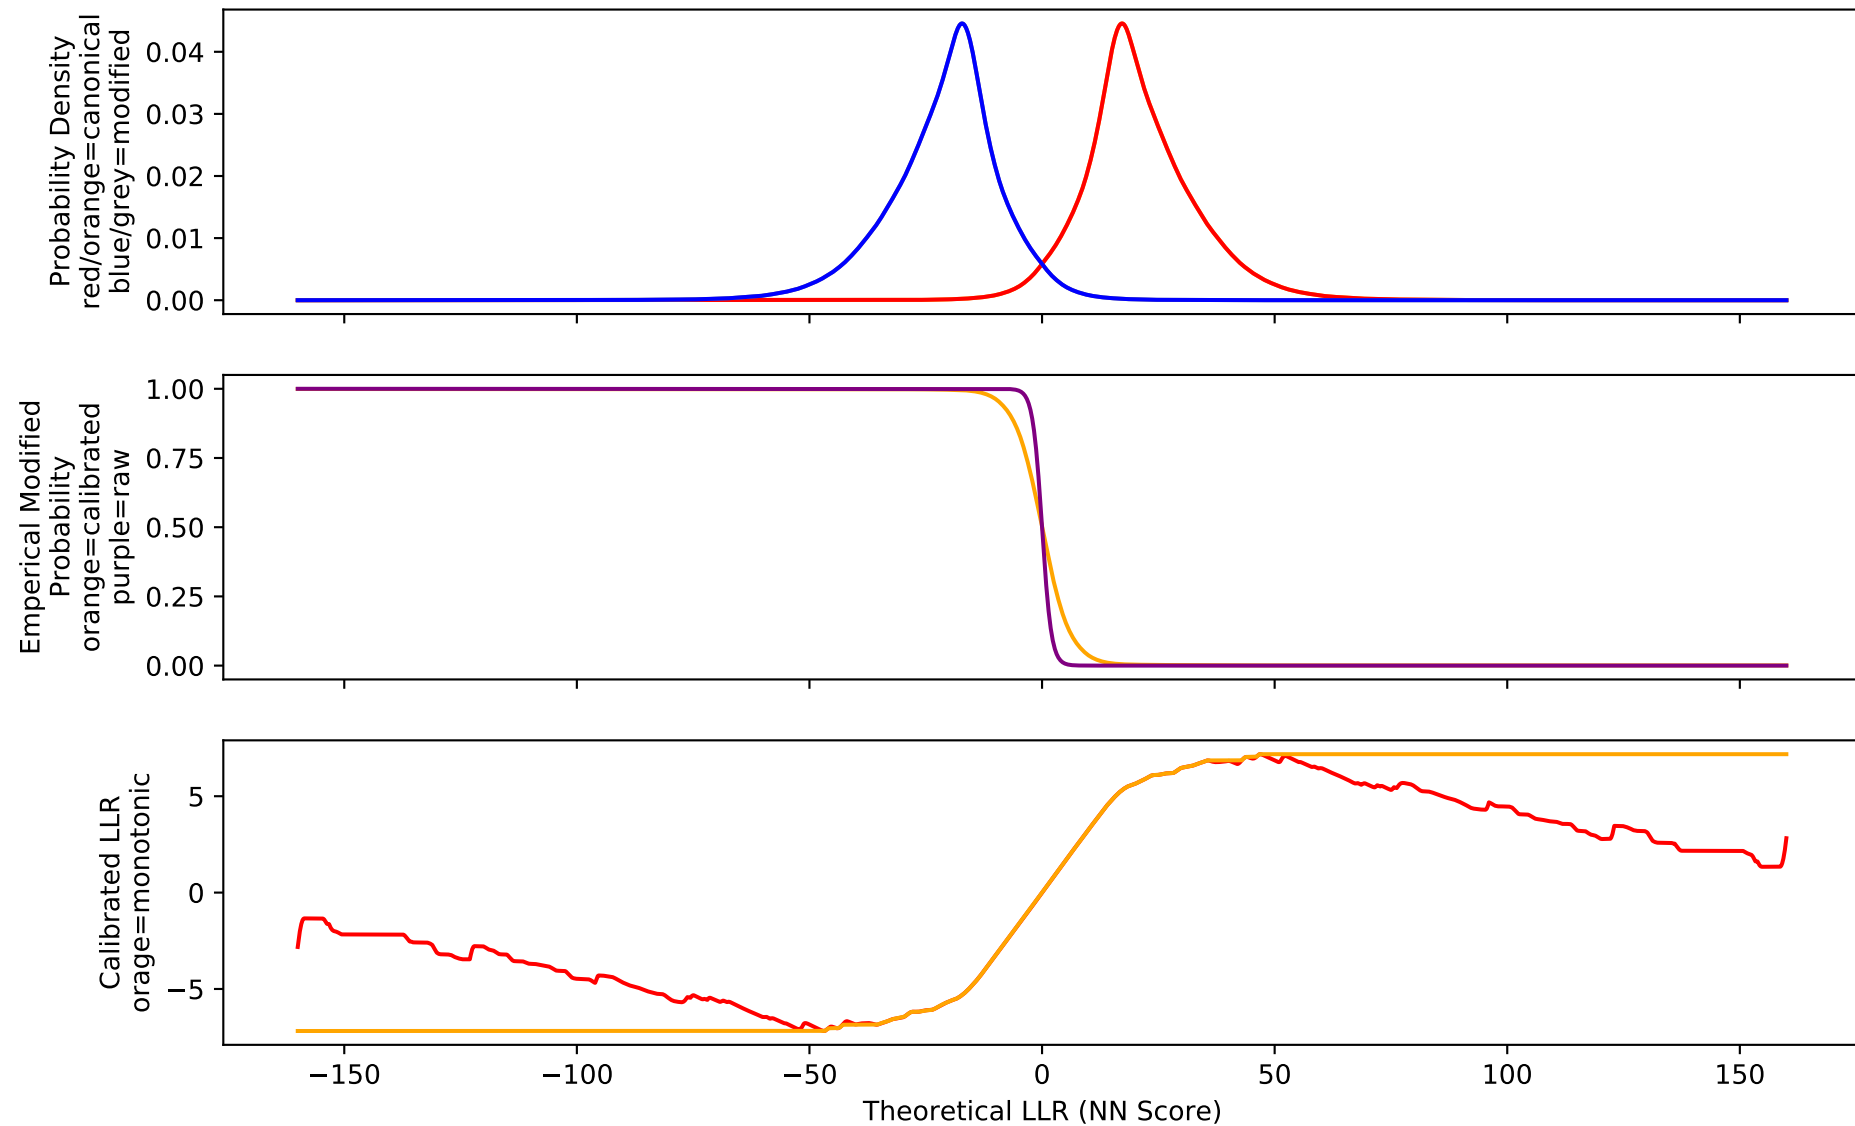


SNP: A -> T Calibration

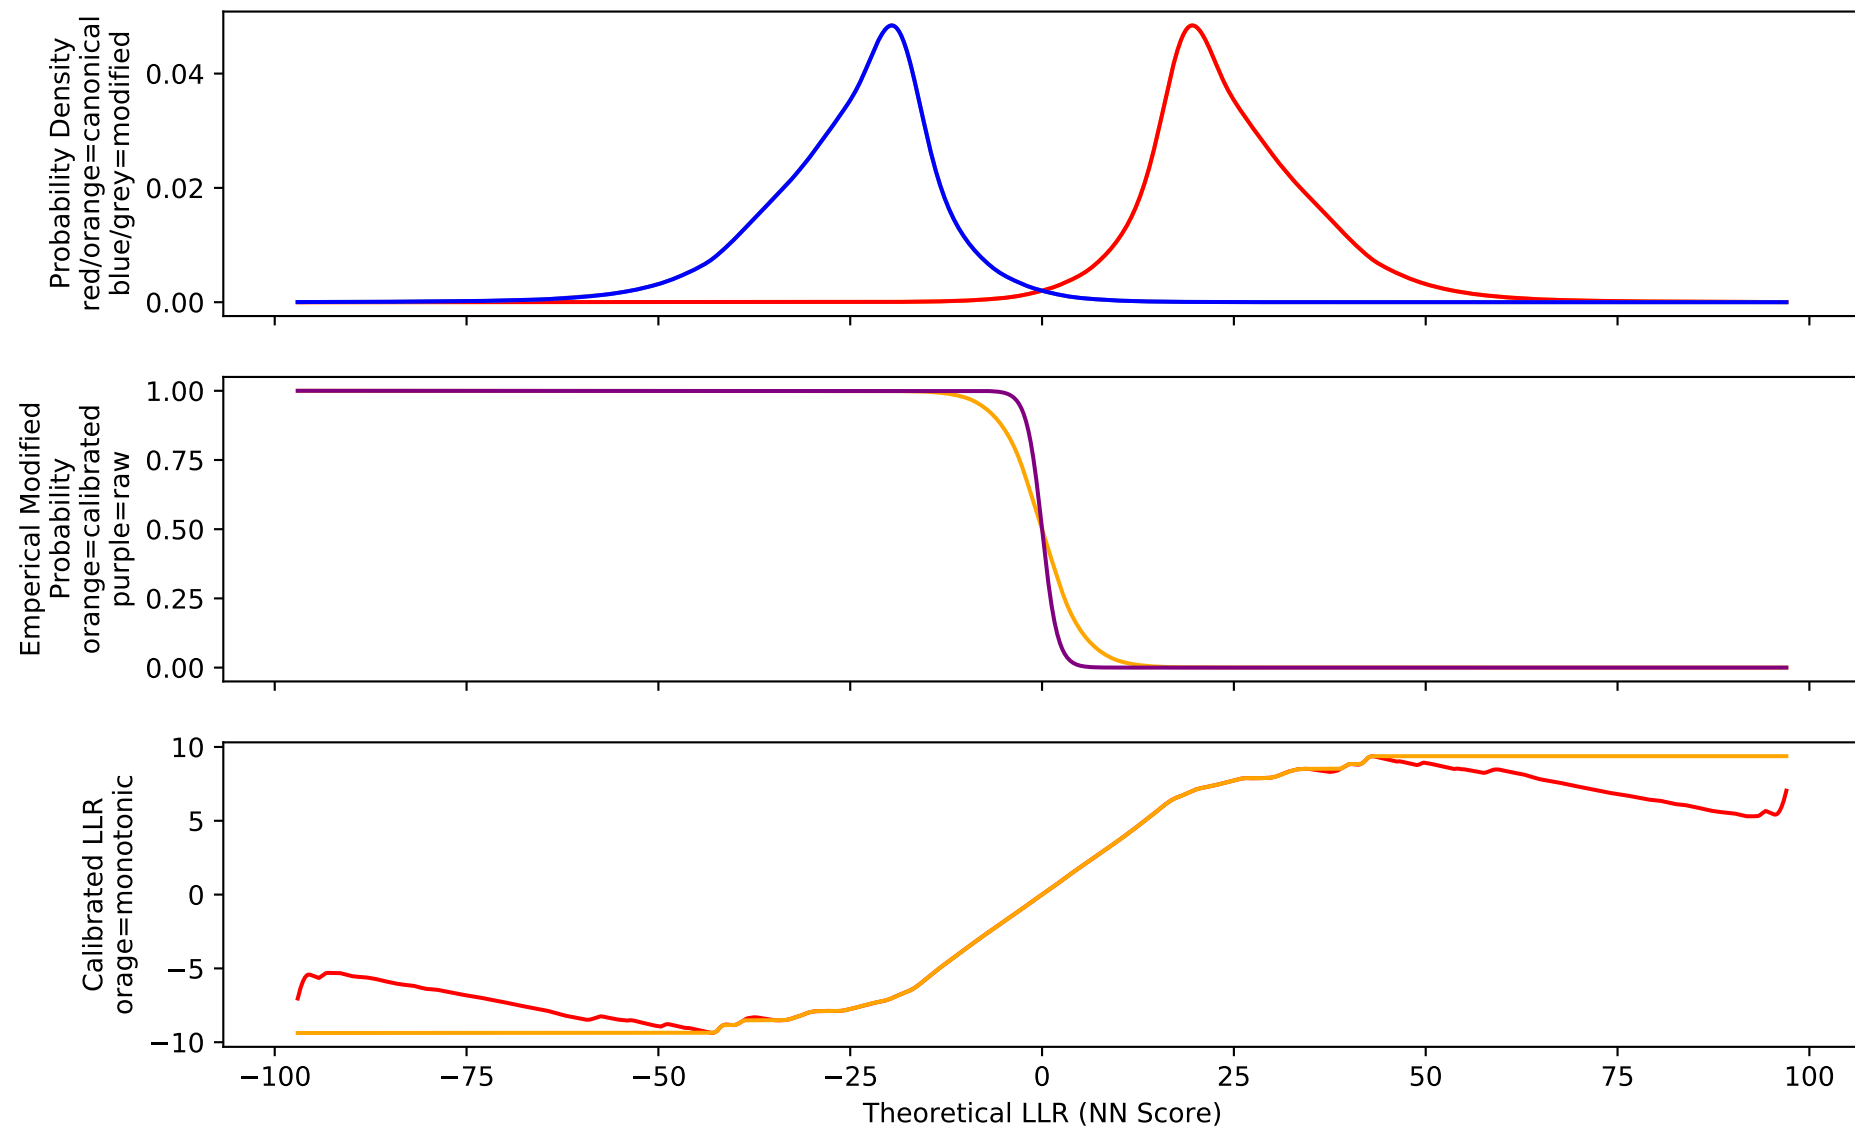


SNP: C -> A Calibration

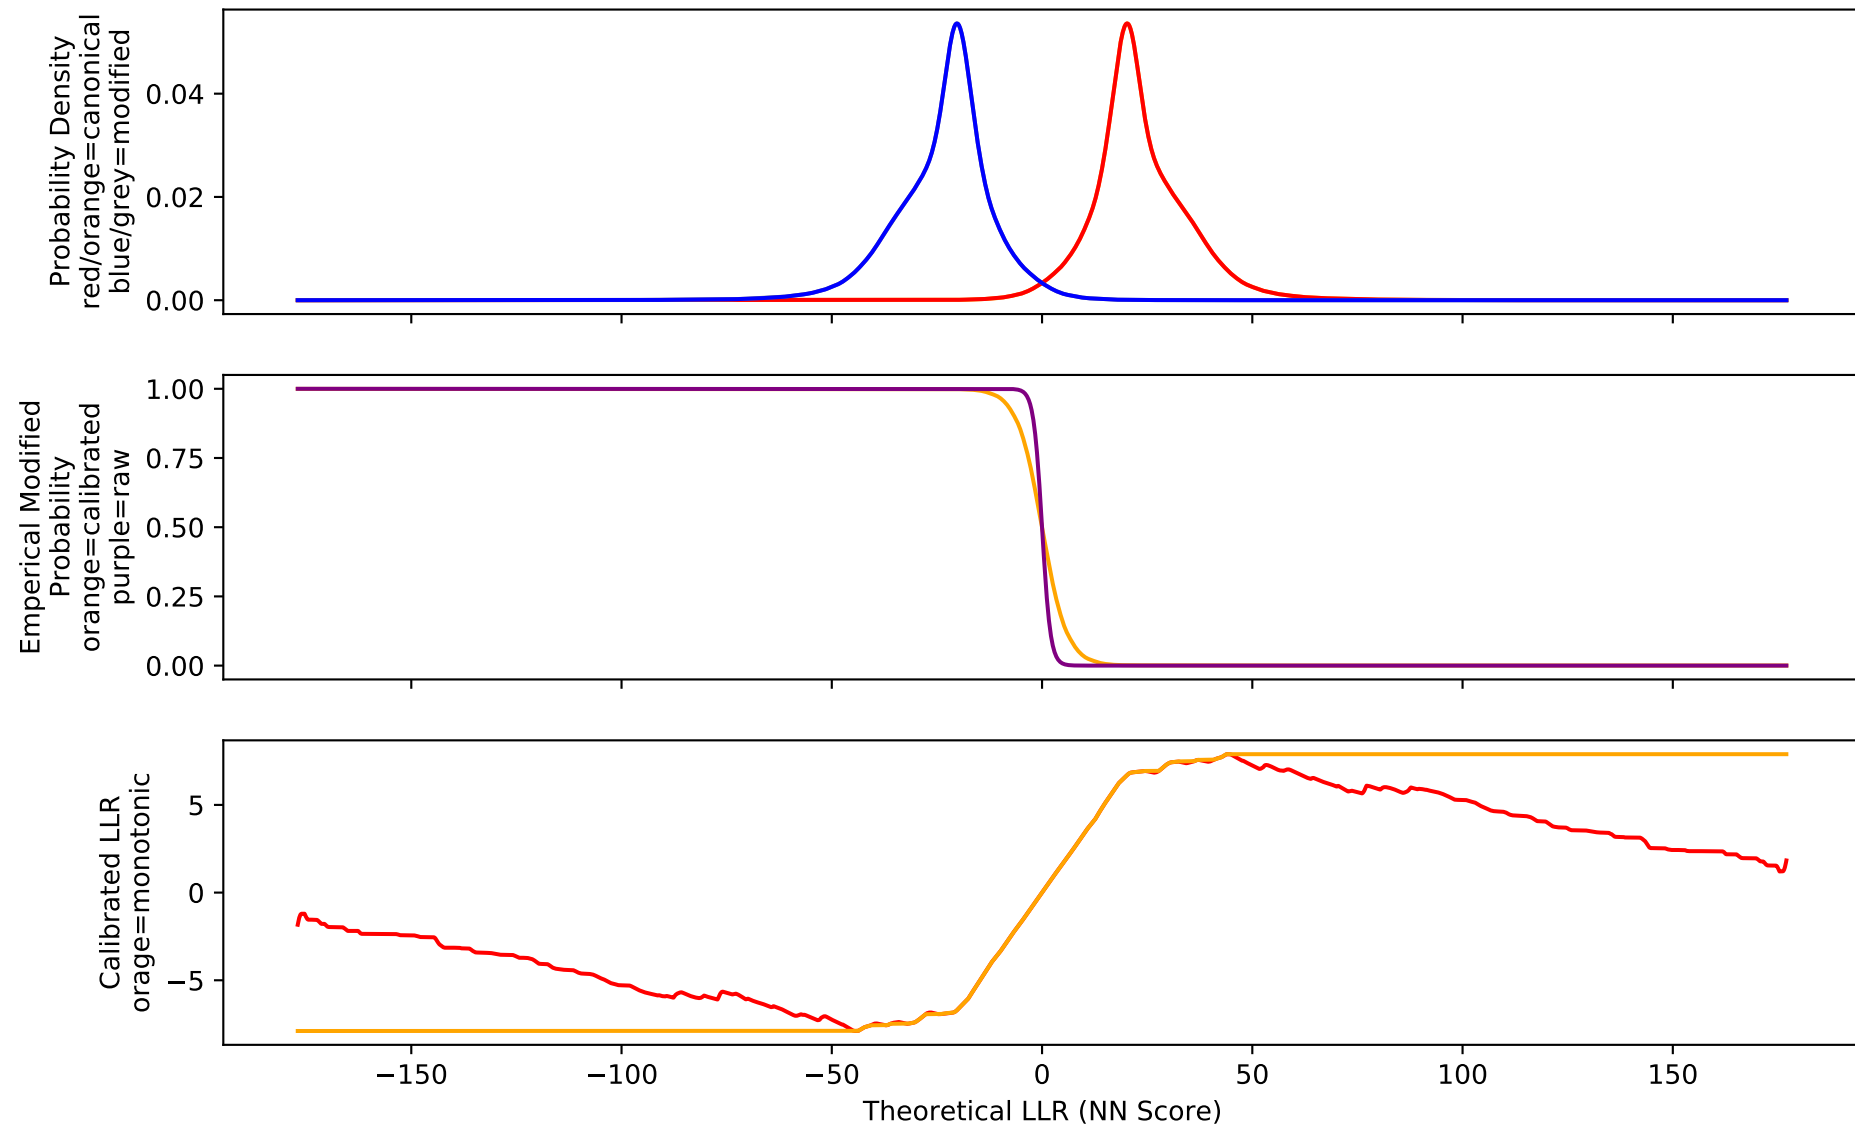


SNP: C -> G Calibration

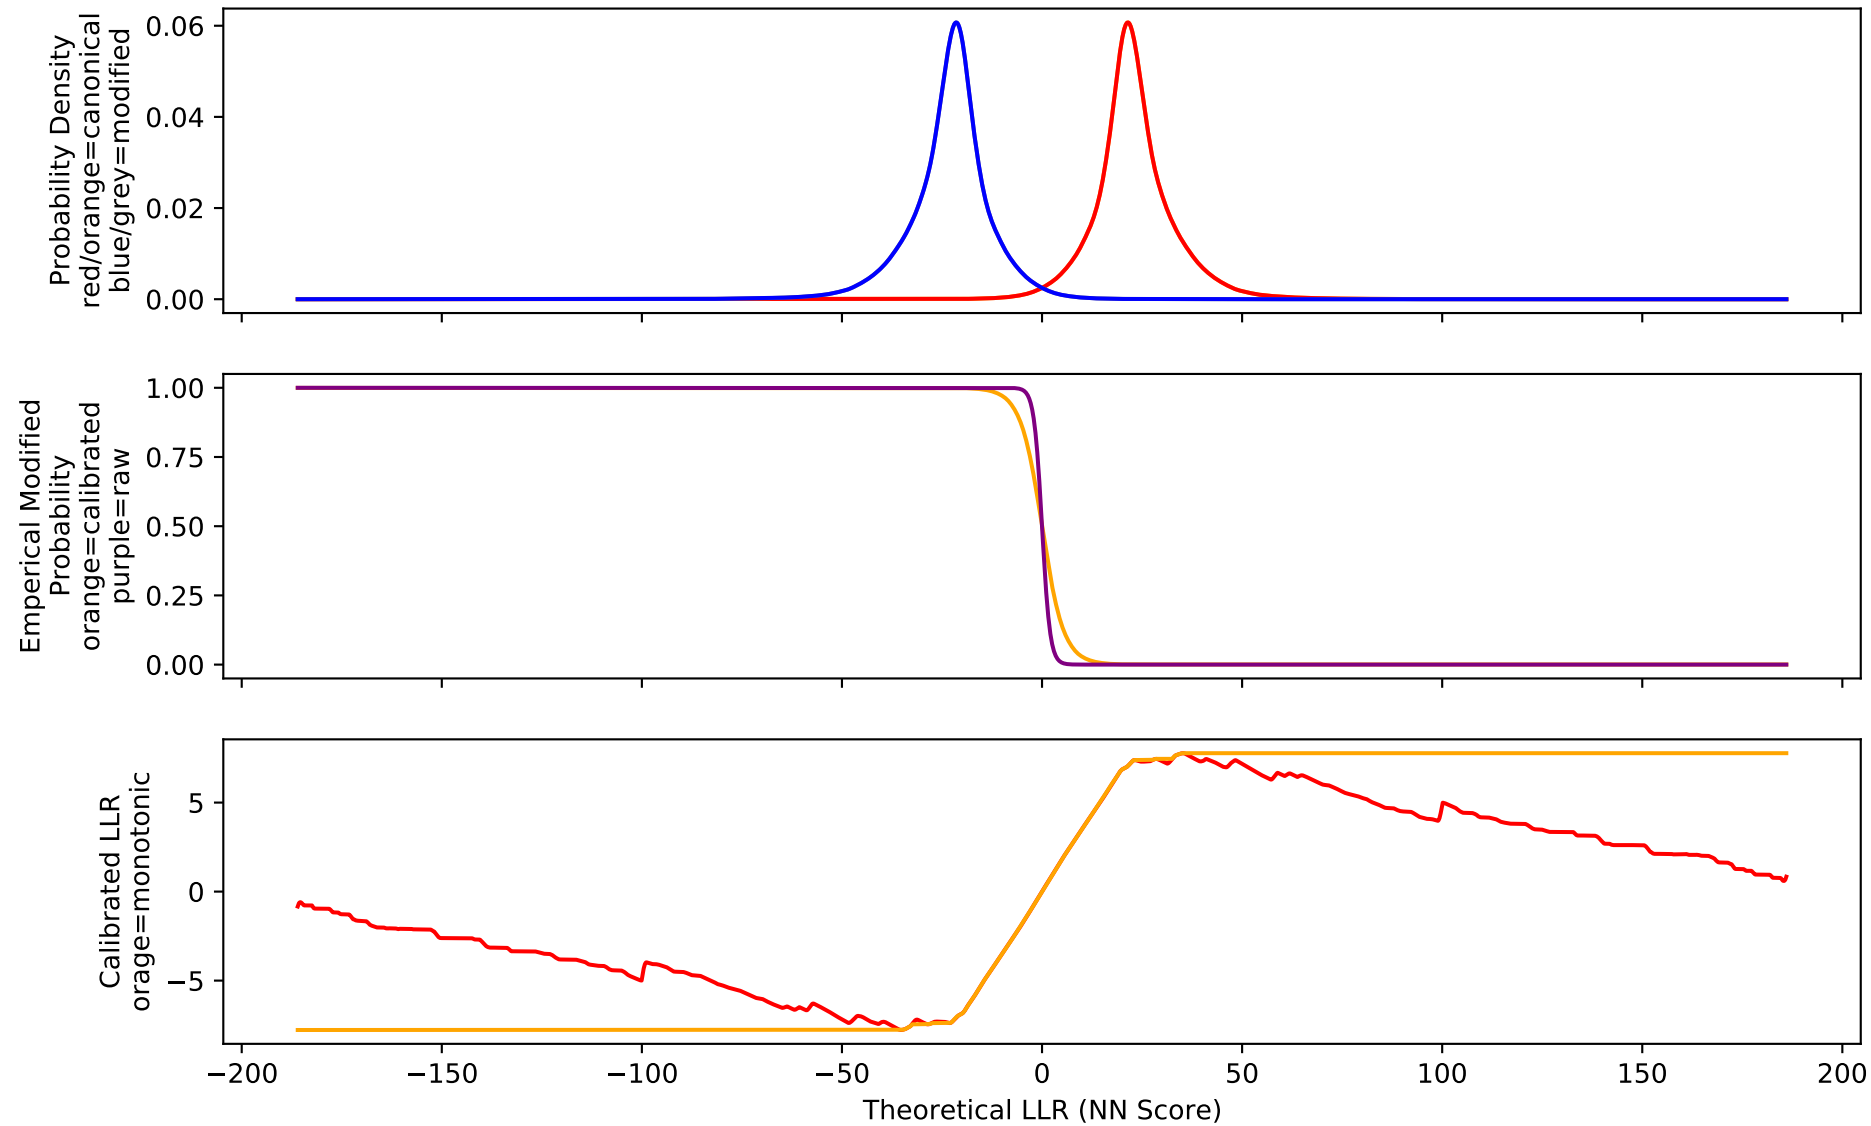


SNP: C -> T Calibration

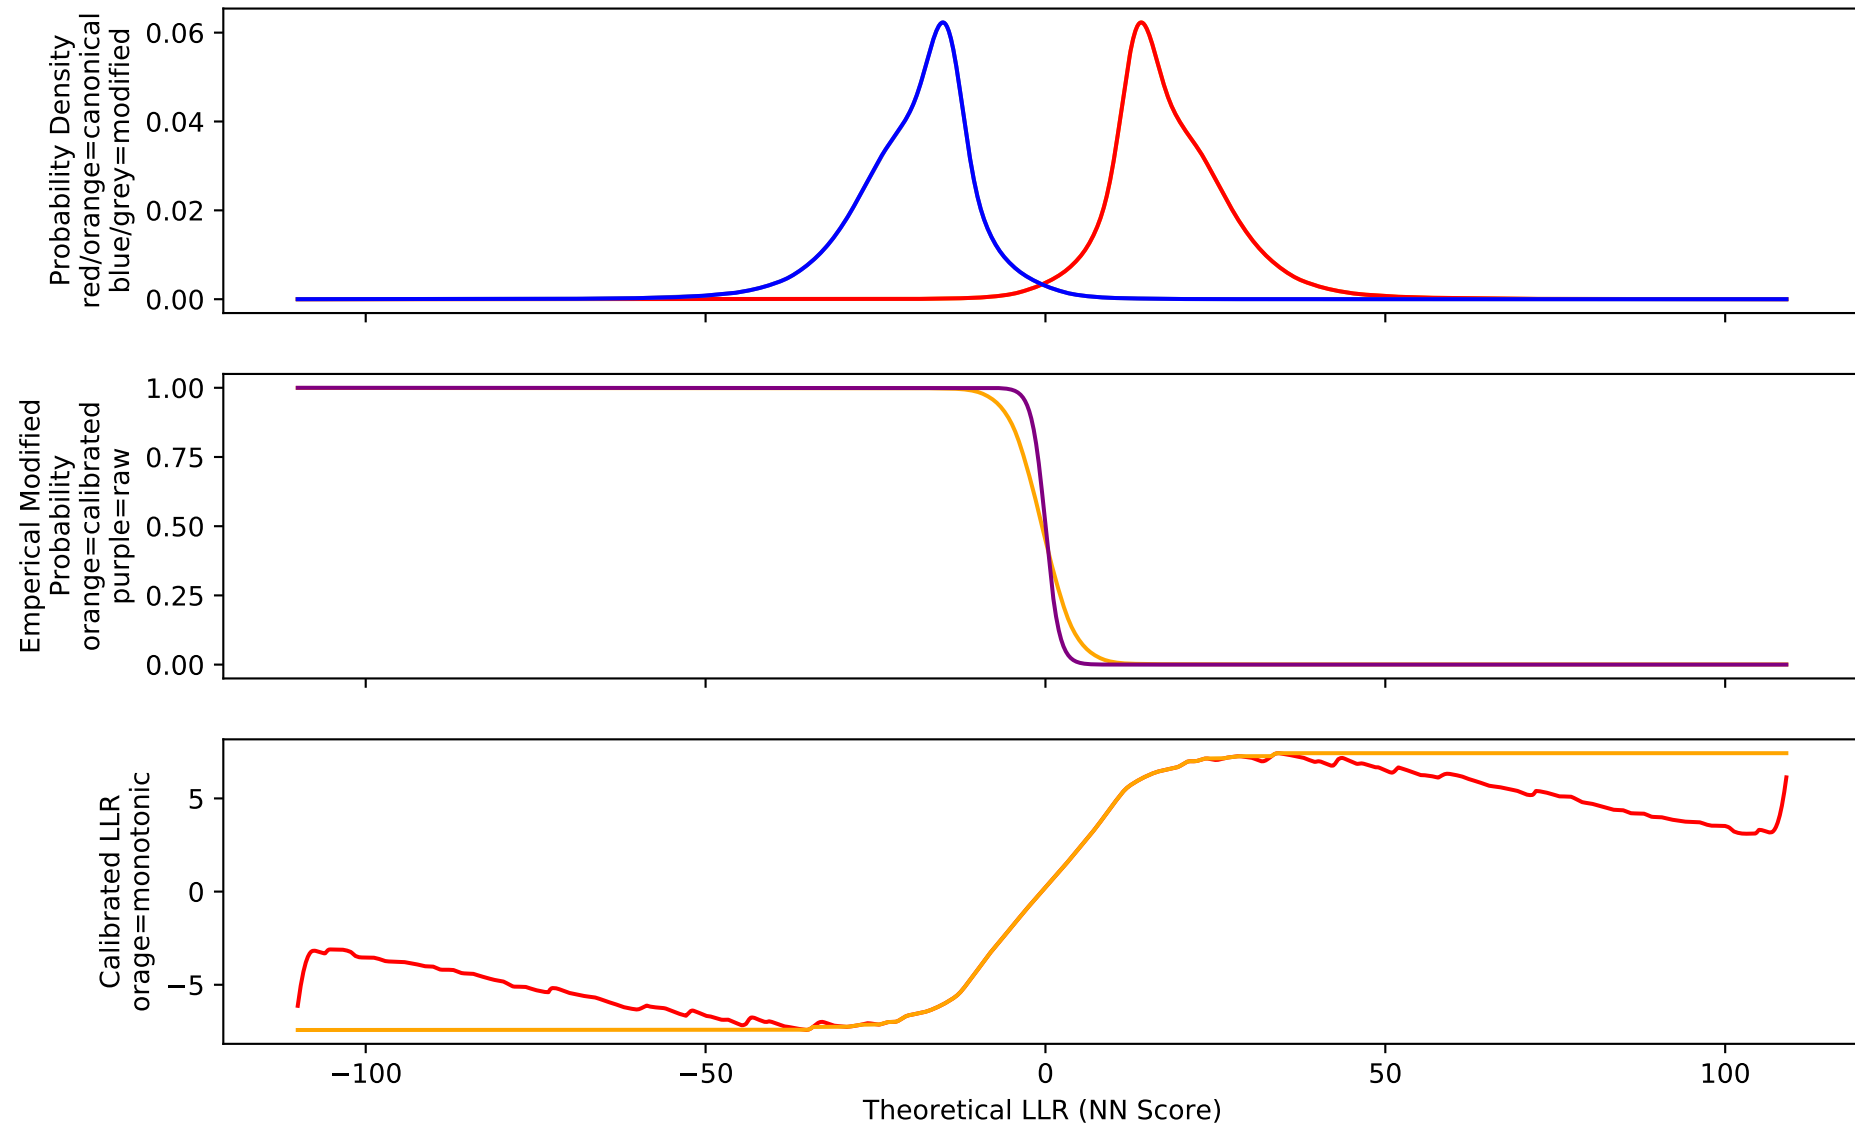

SNP: G -> A Calibration

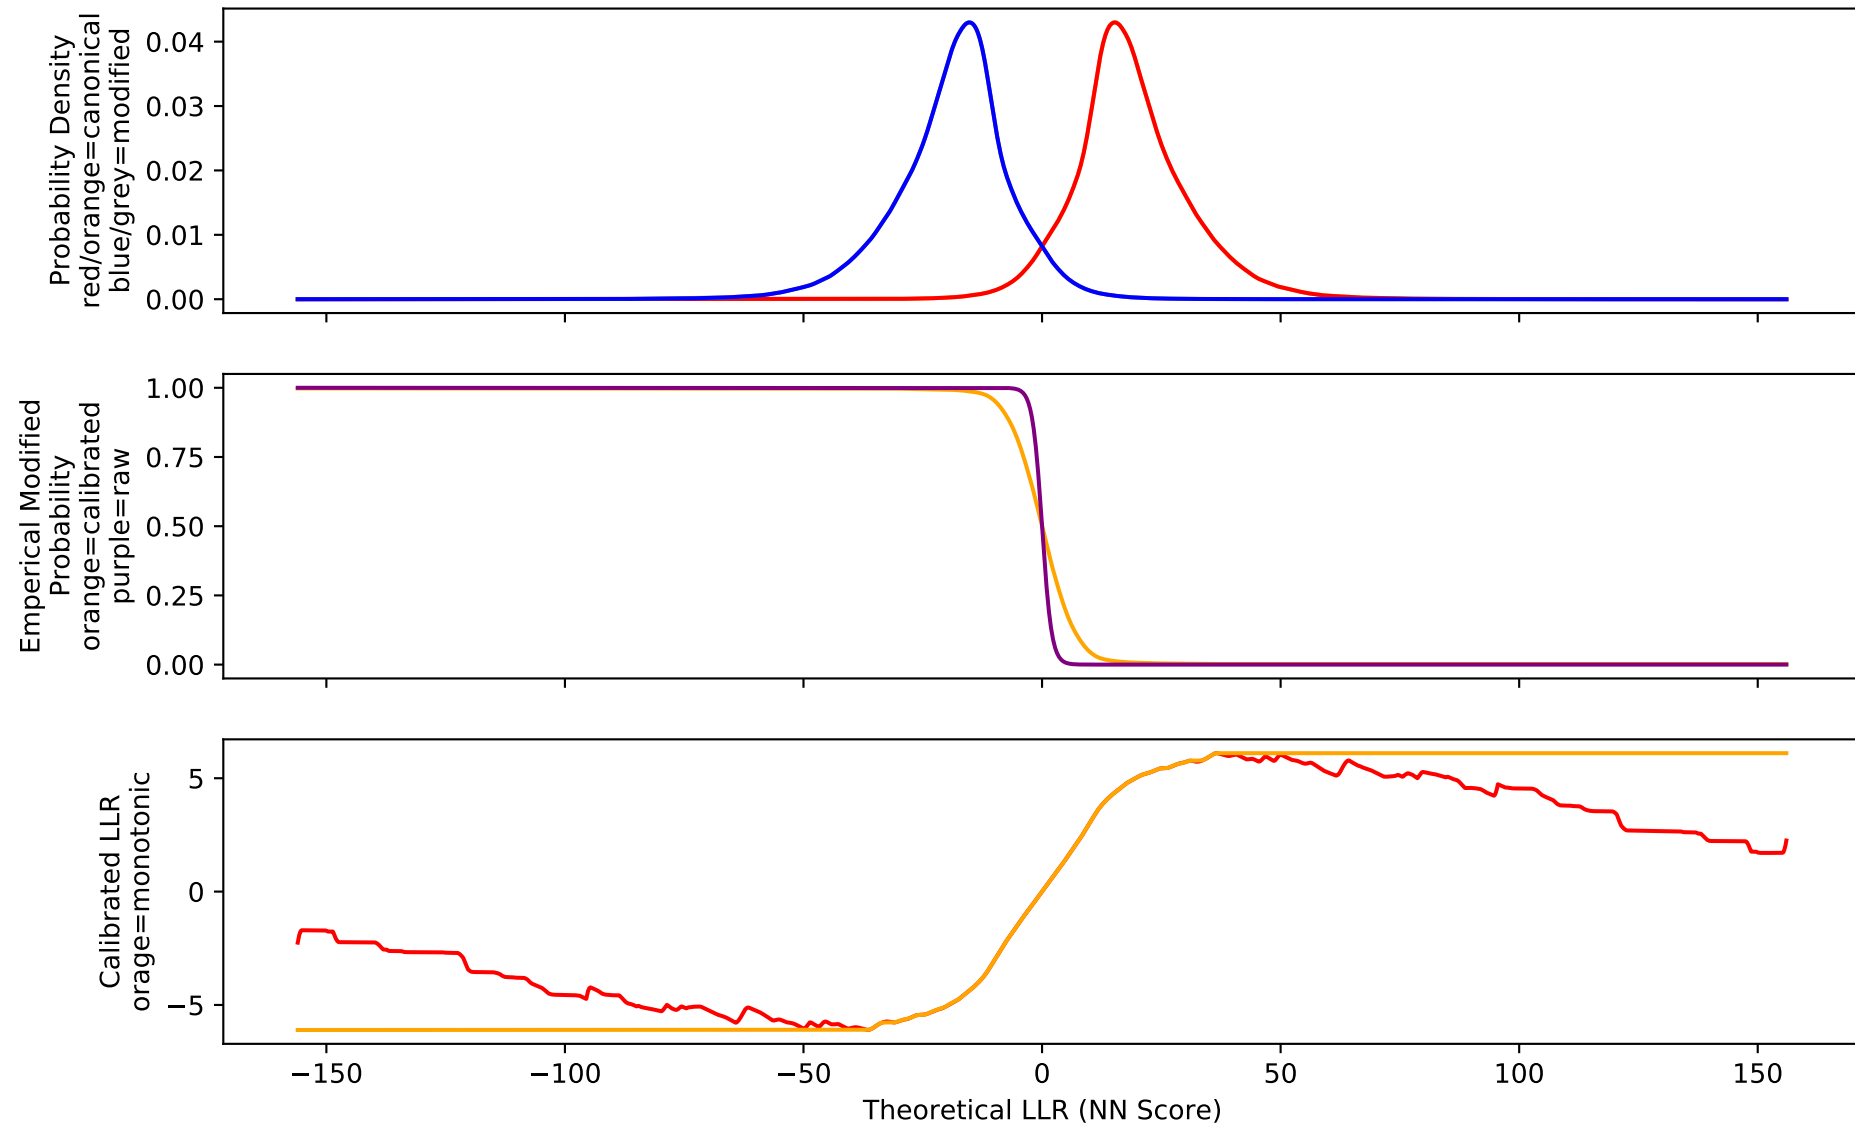


SNP: G -> C Calibration

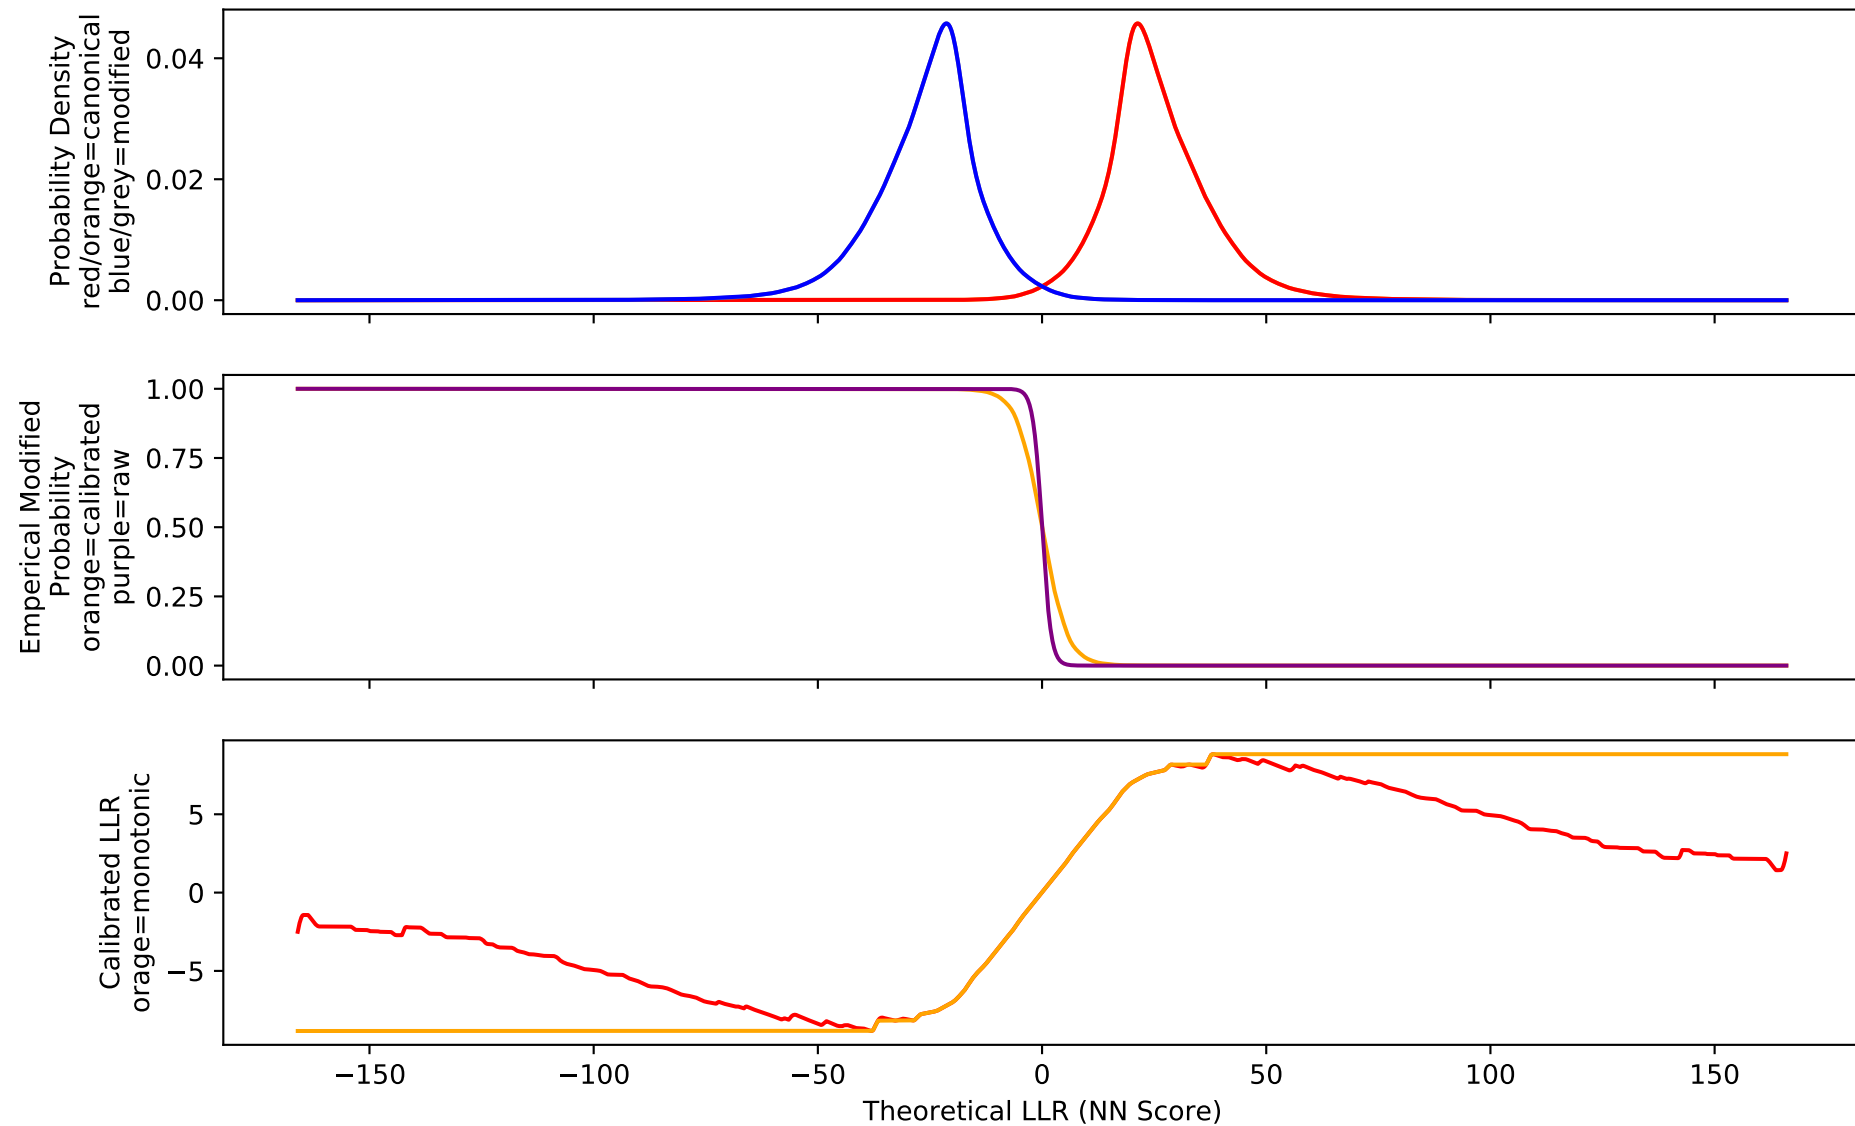





SNP: G -> T Calibration

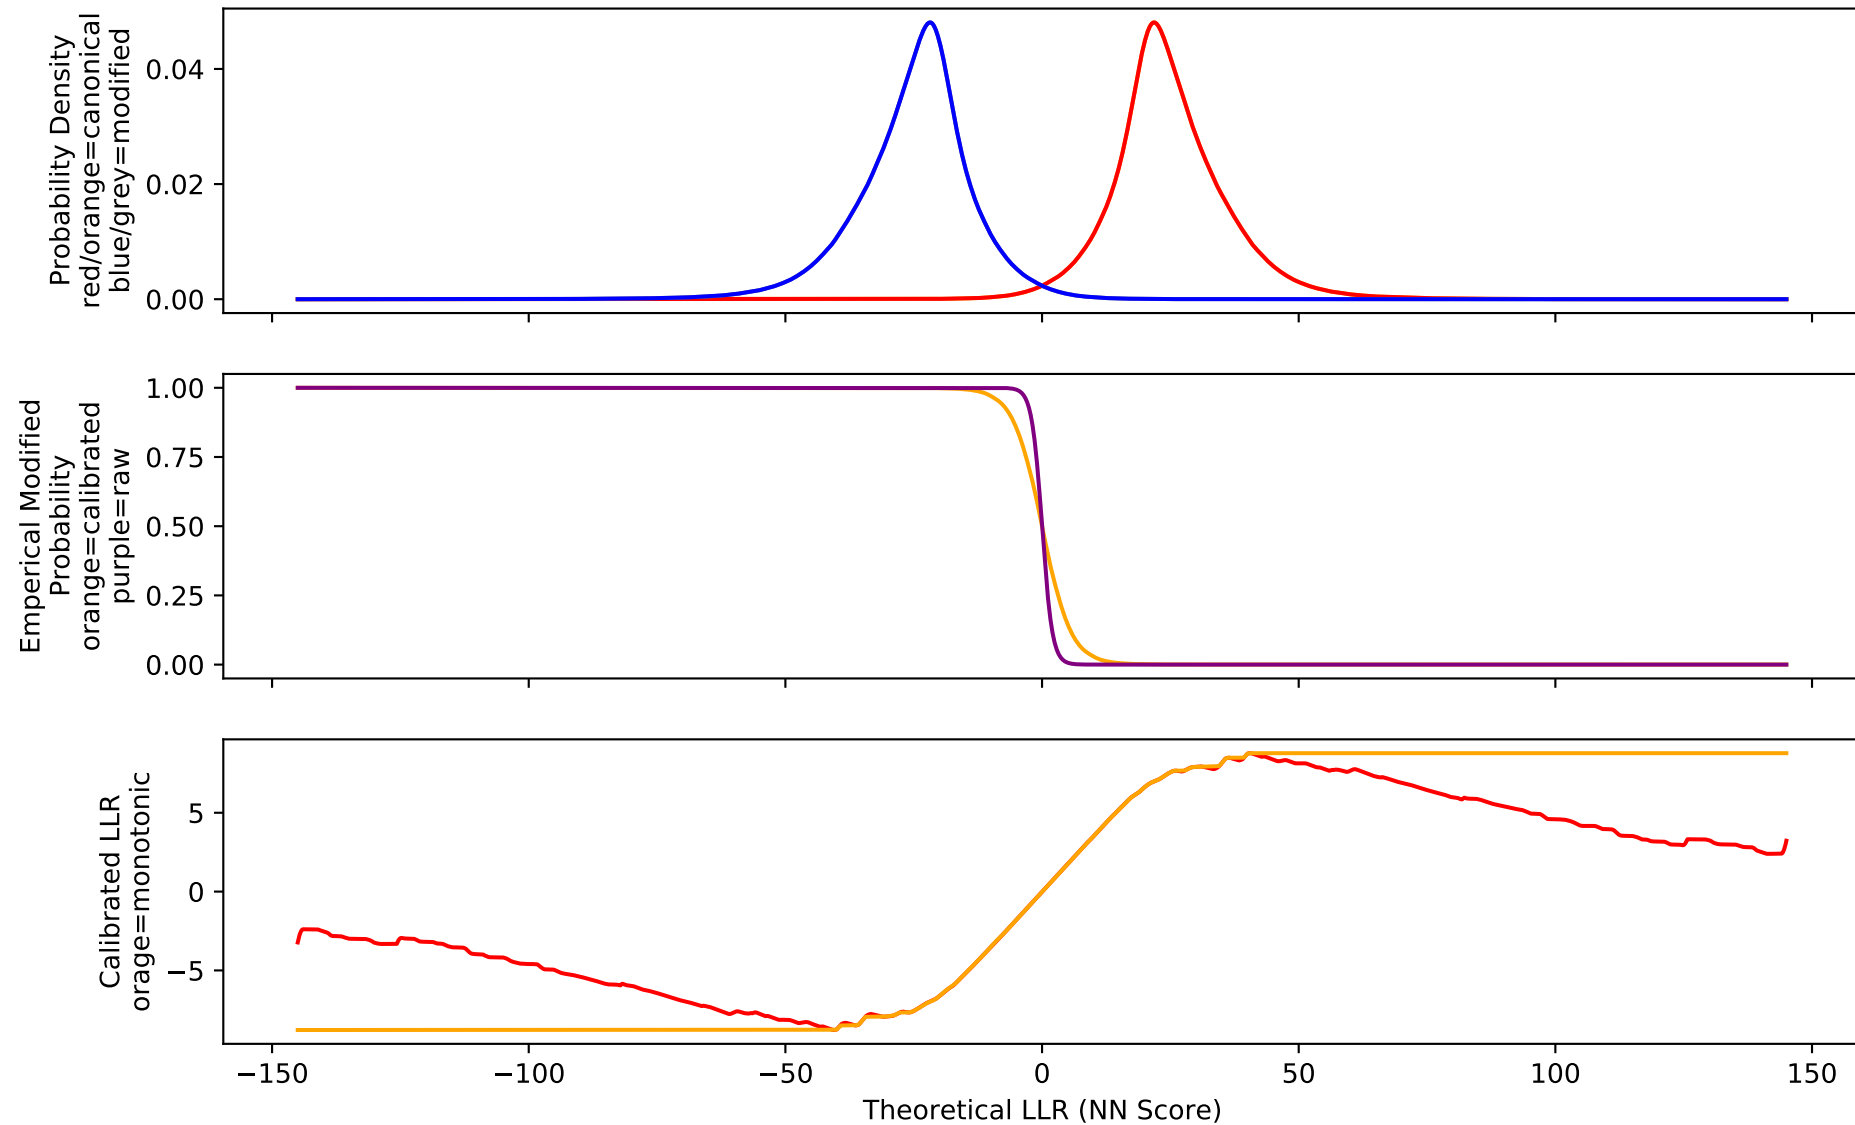


SNP: N -> N Calibration

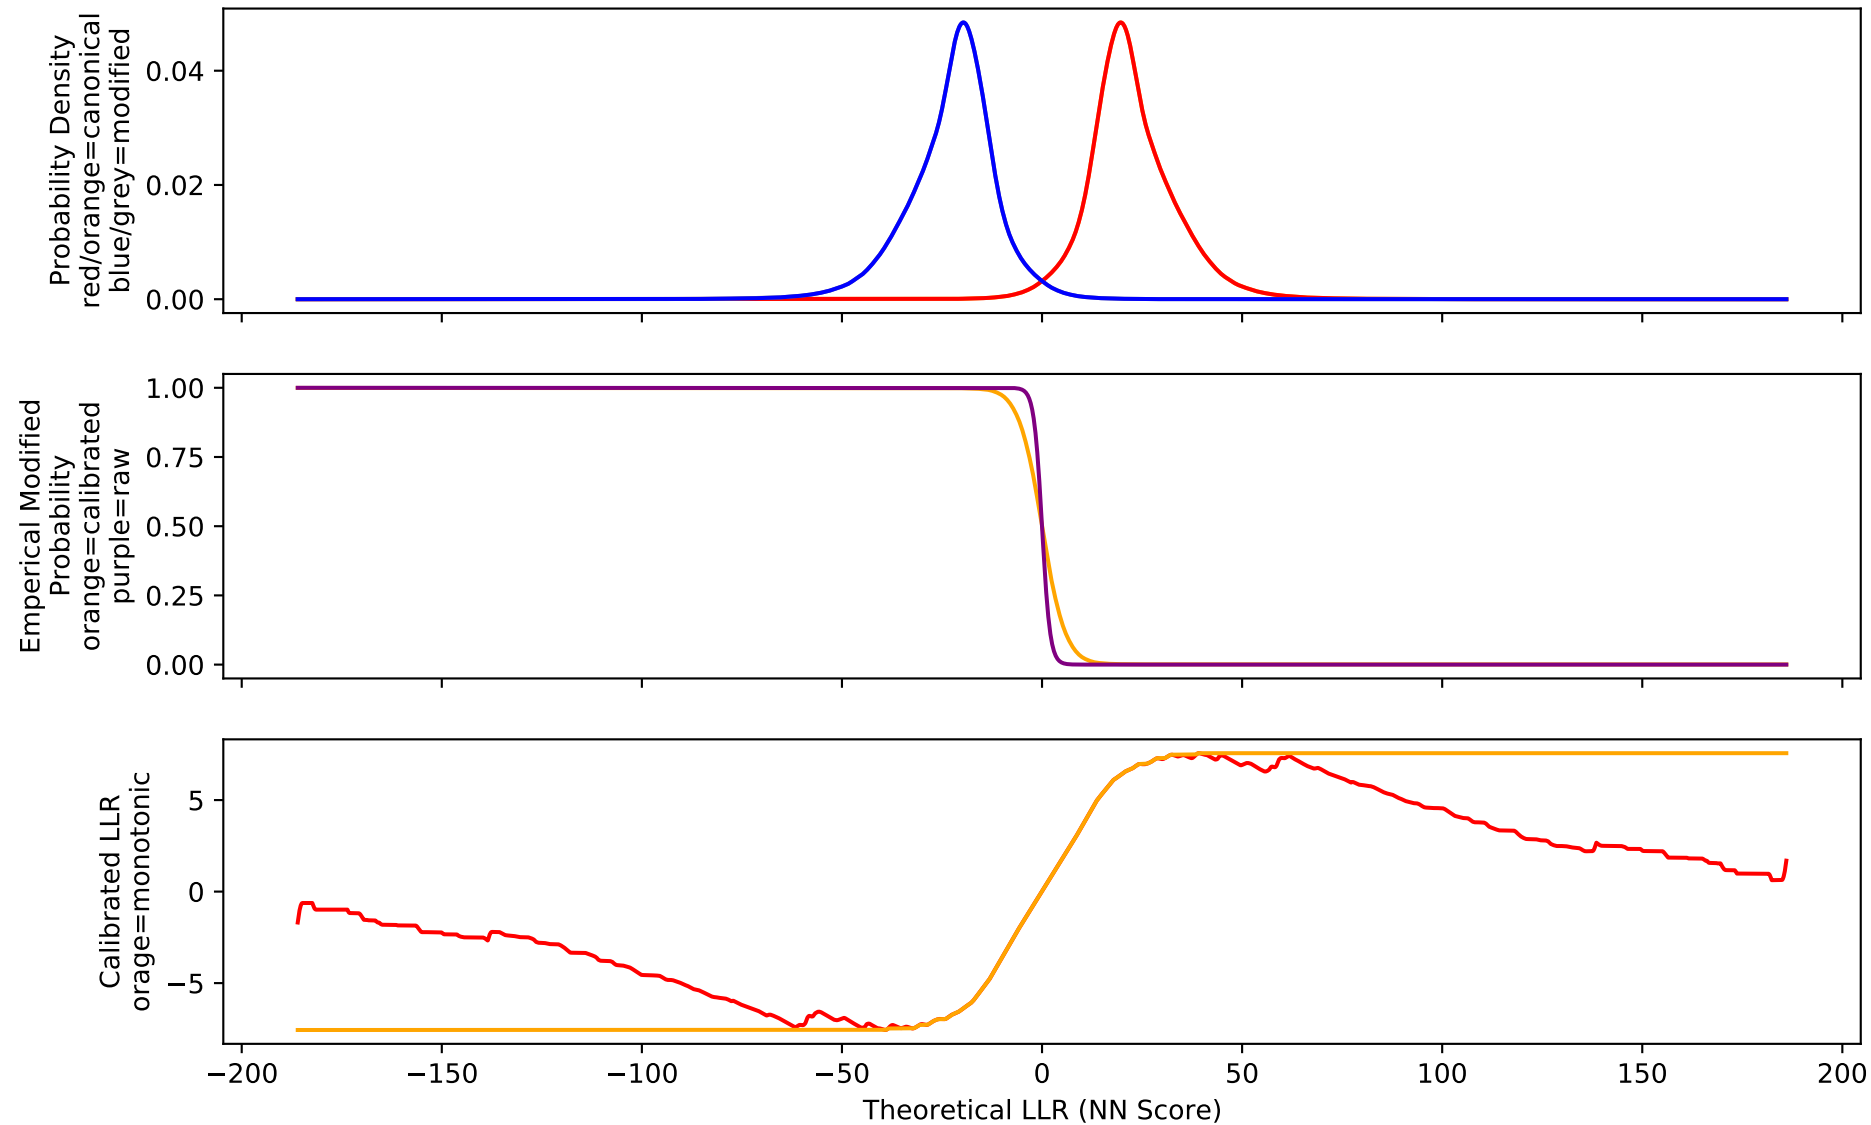


SNP: T -> A Calibration

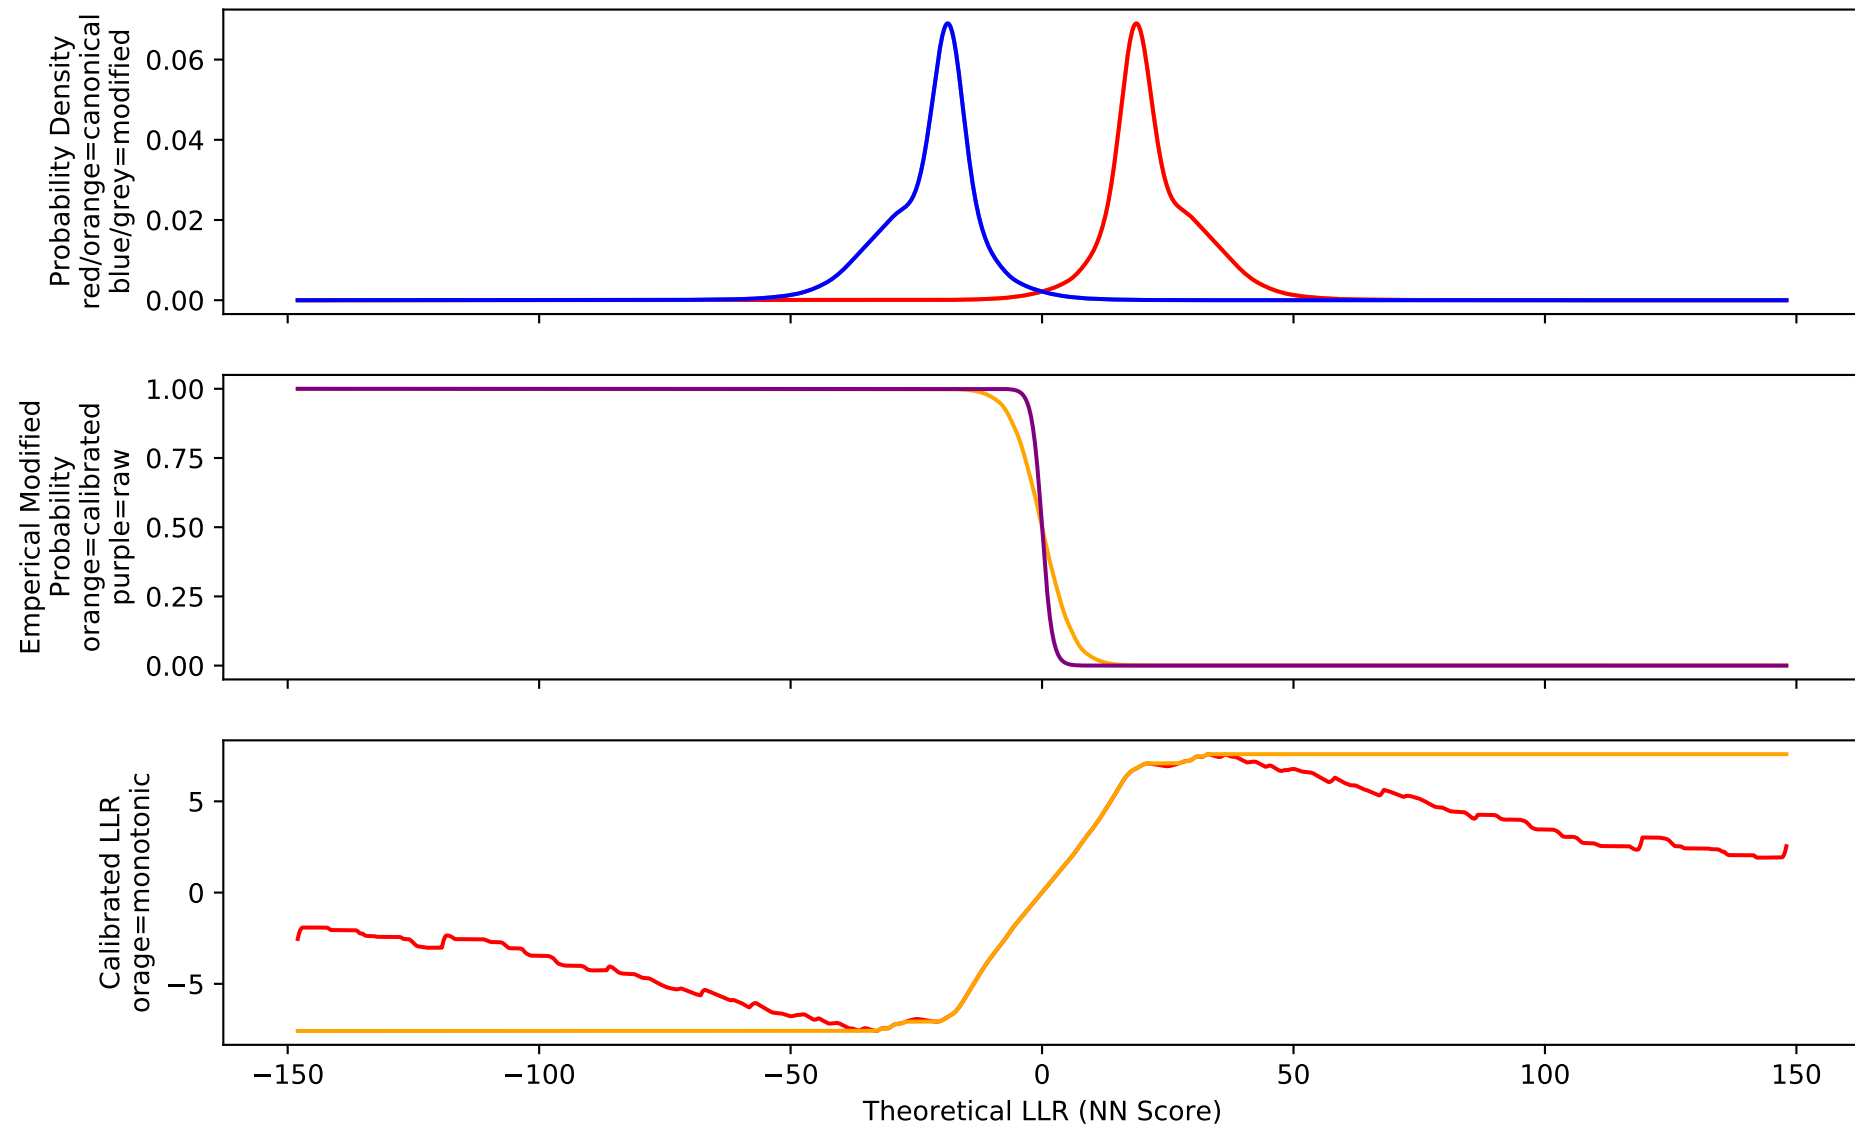


SNP: T -> C Calibration

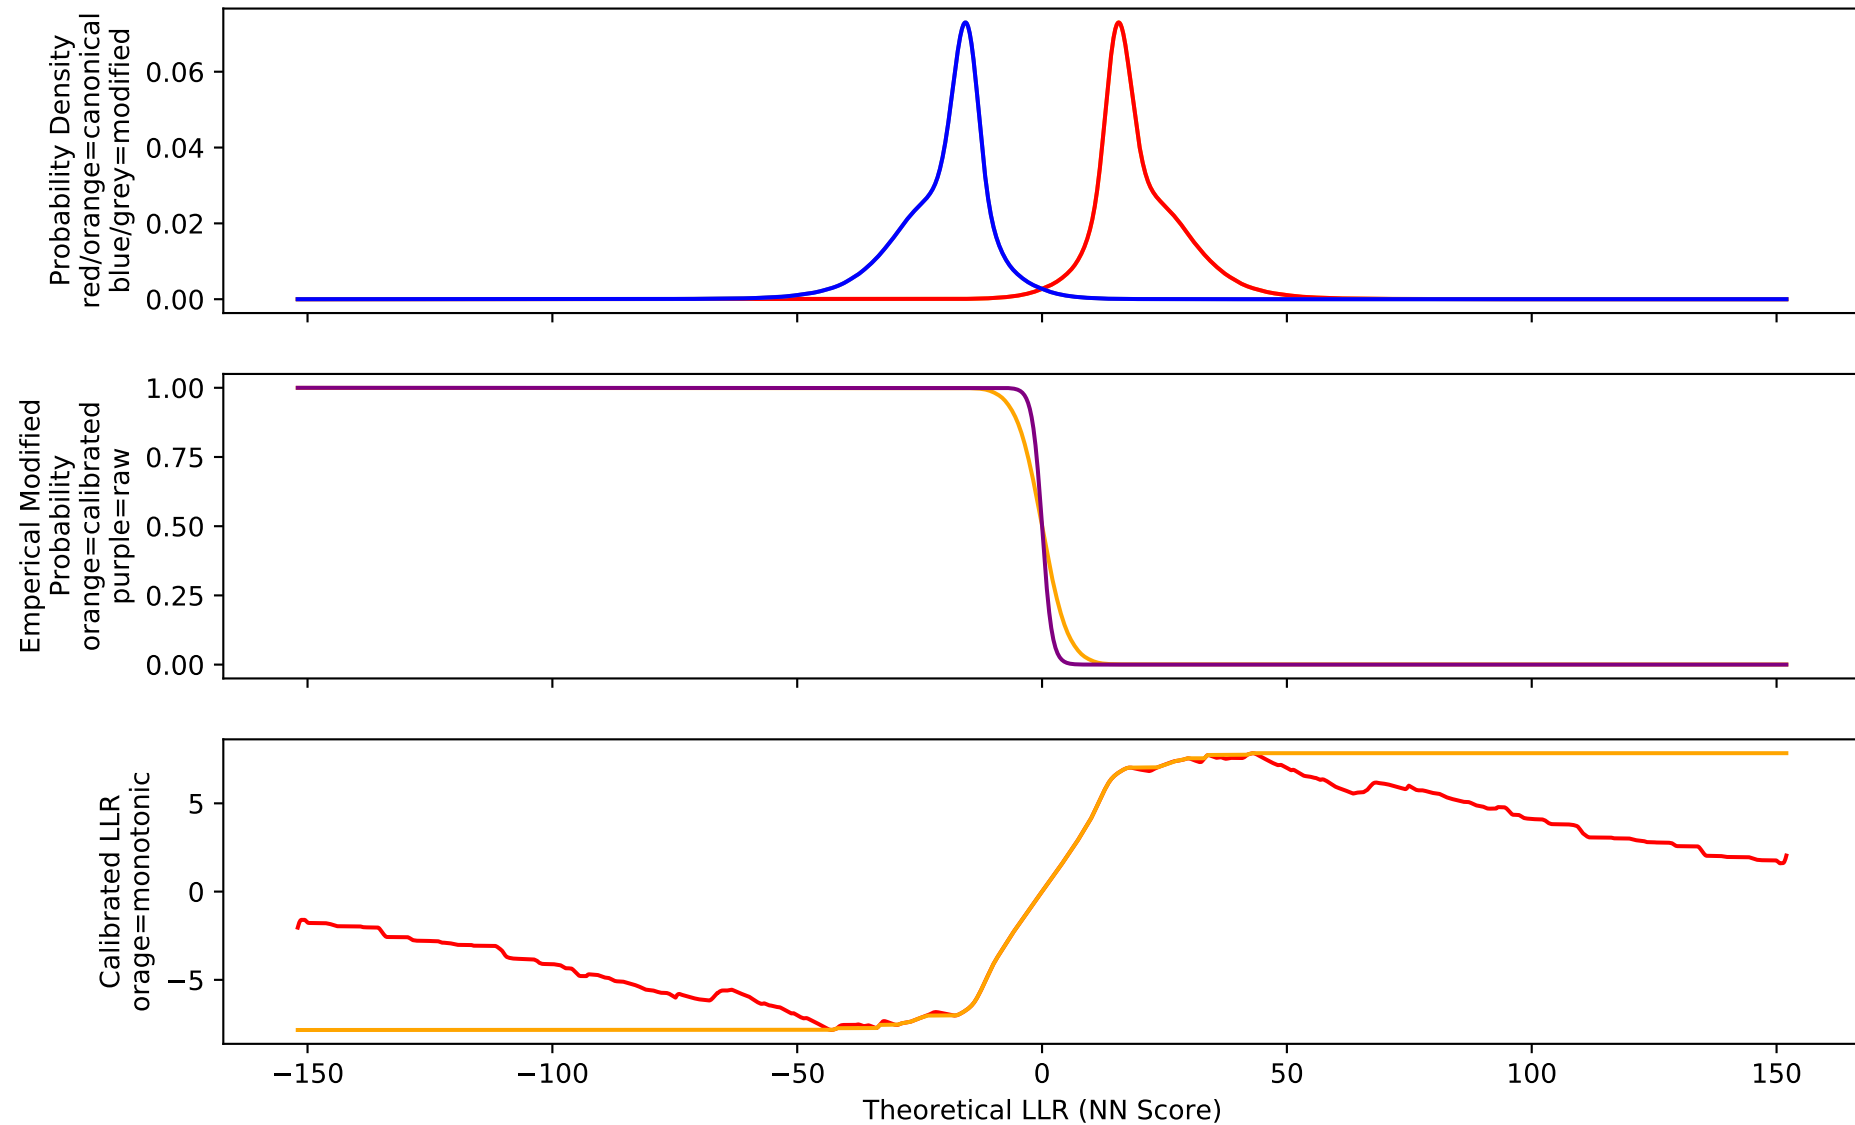


SNP: T -> G Calibration

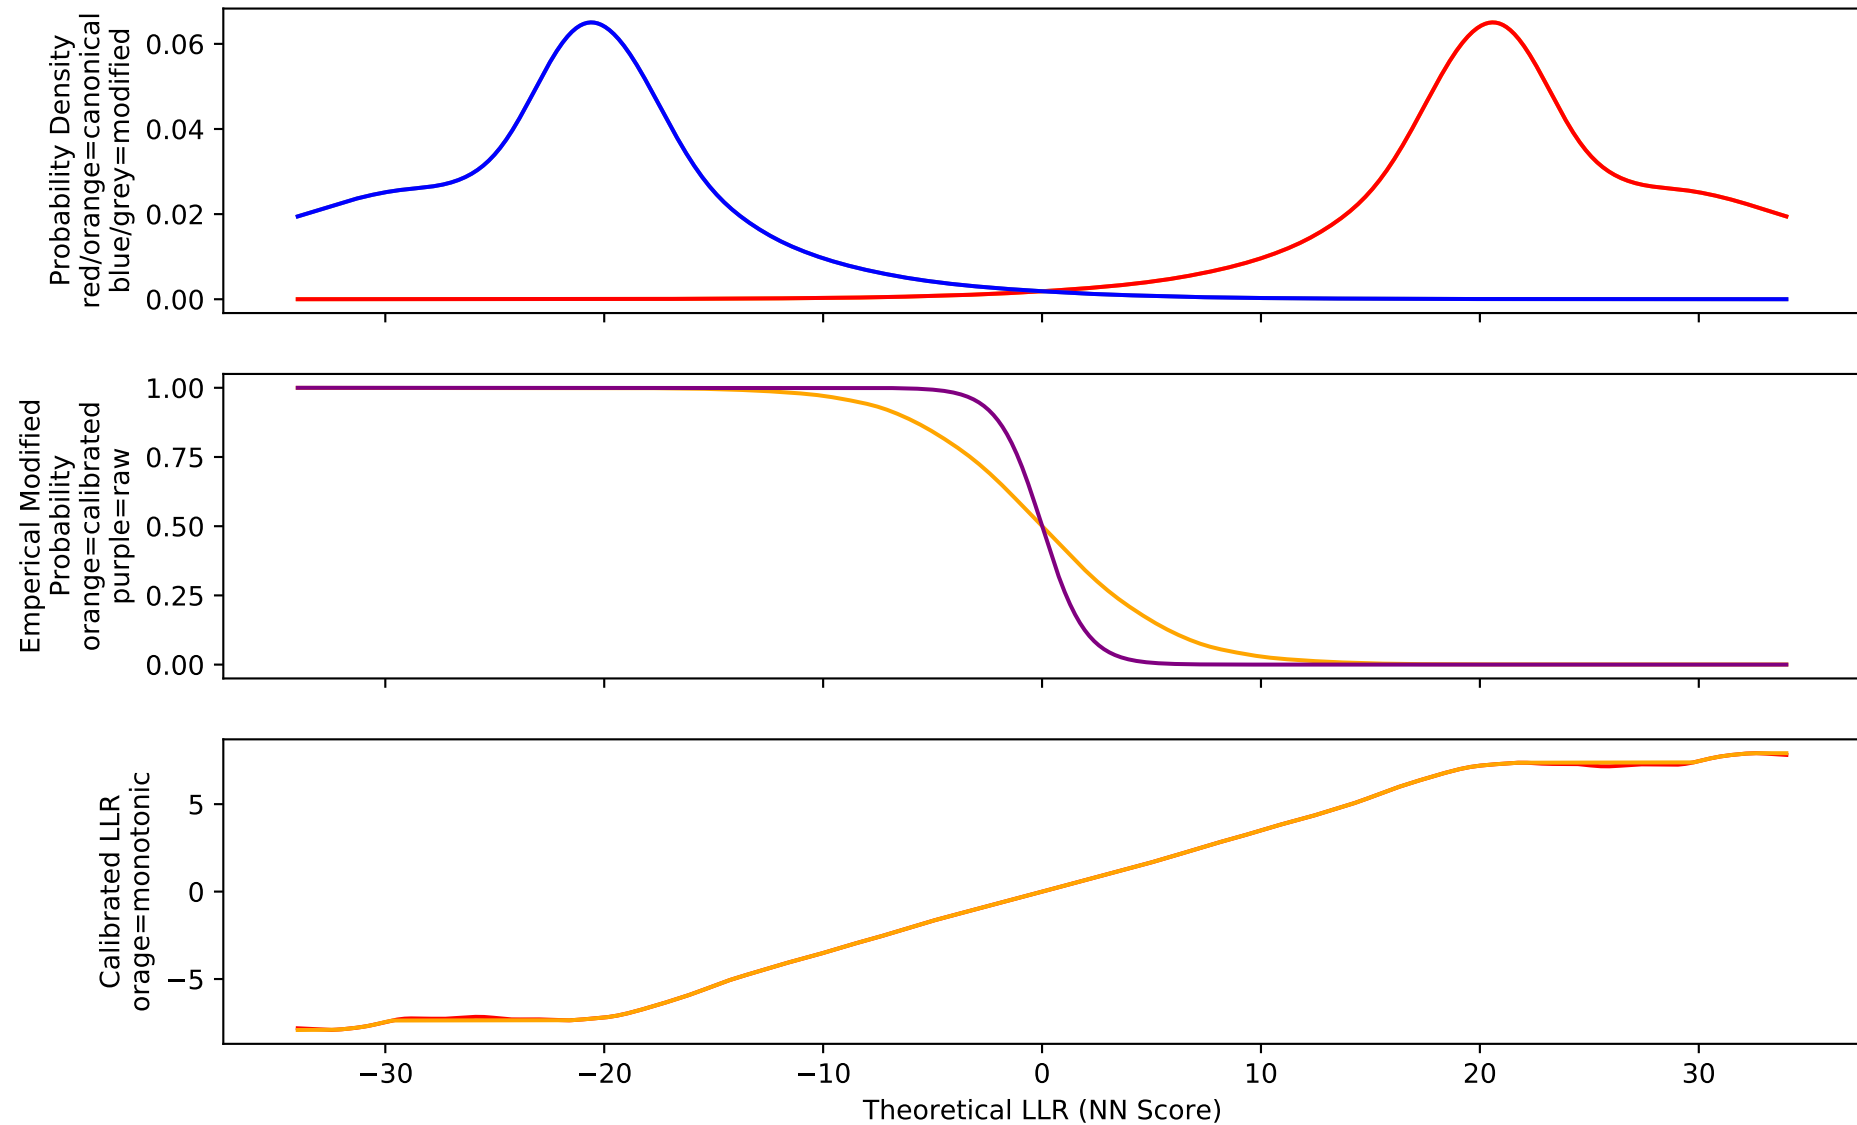


Deletion Length 1 Calibration

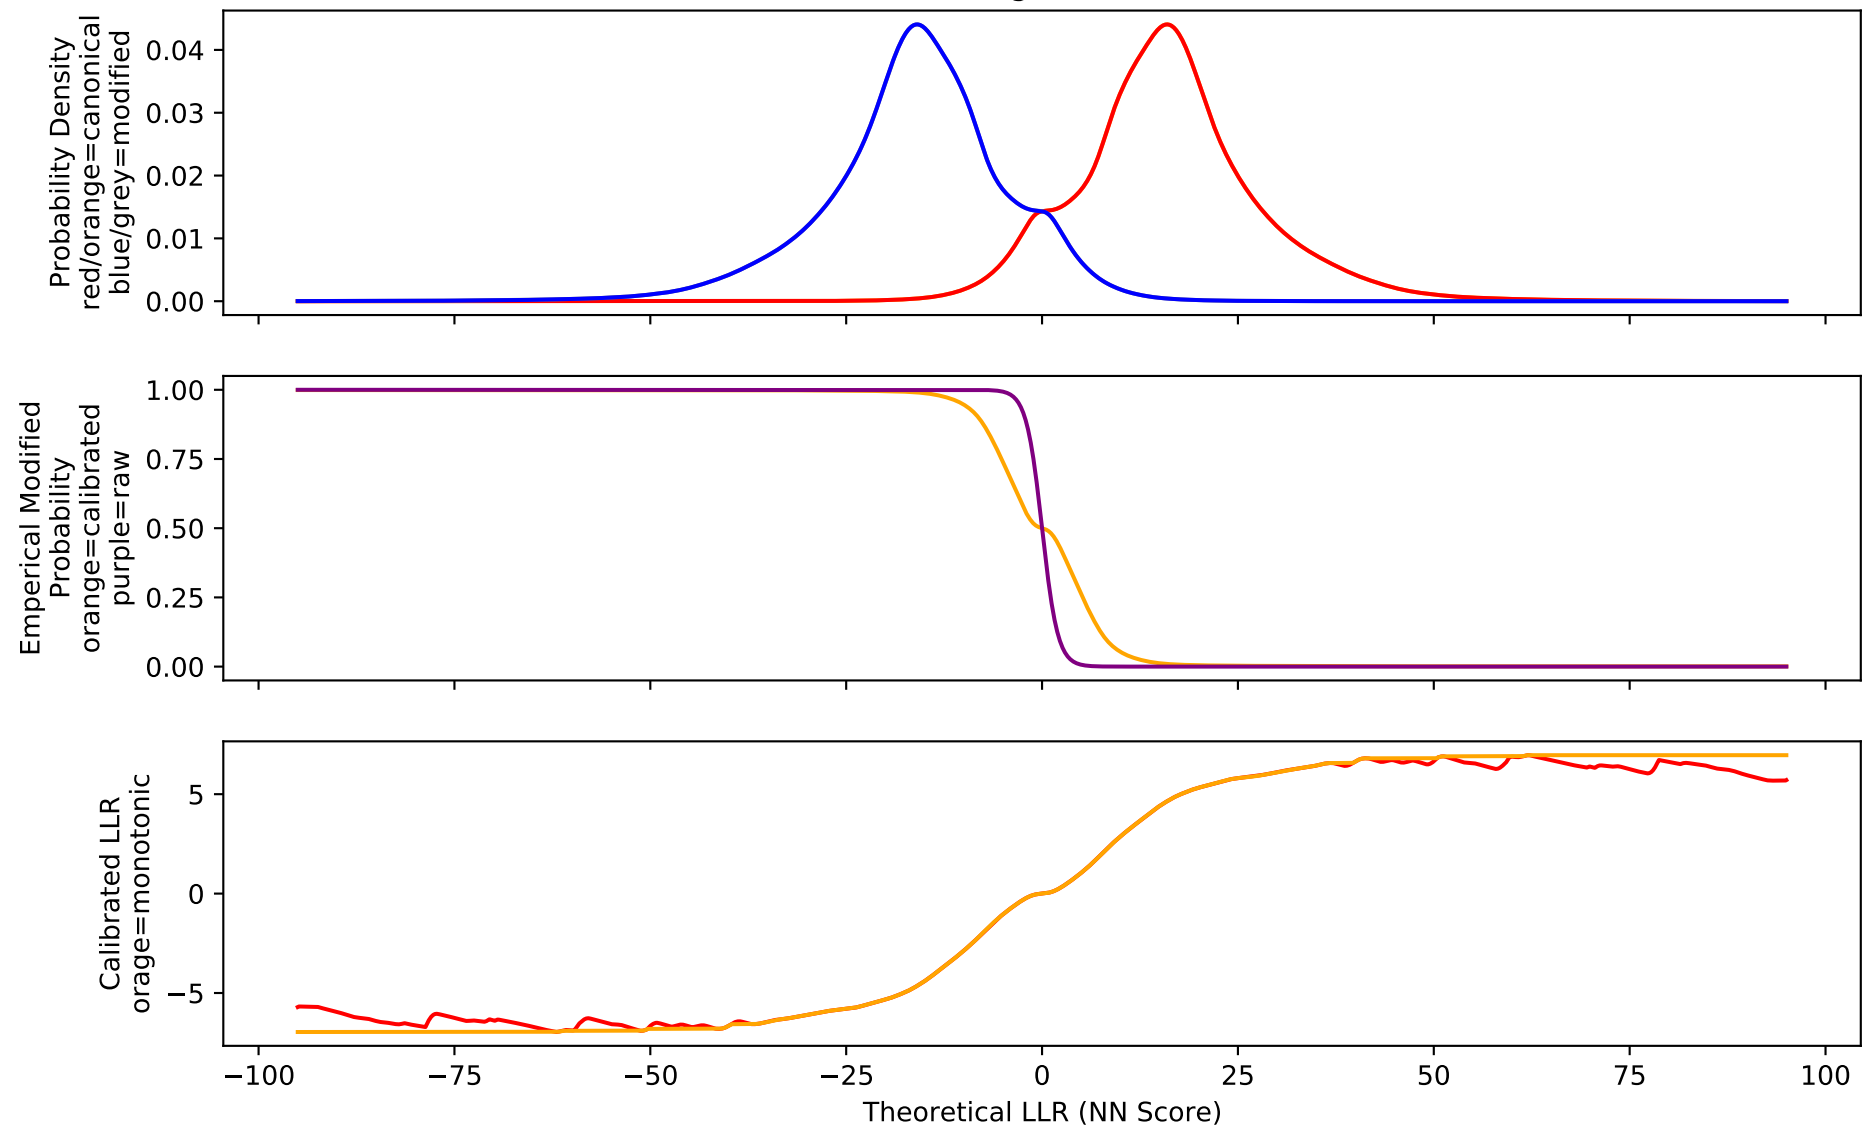

Deletion Length 2 Calibration

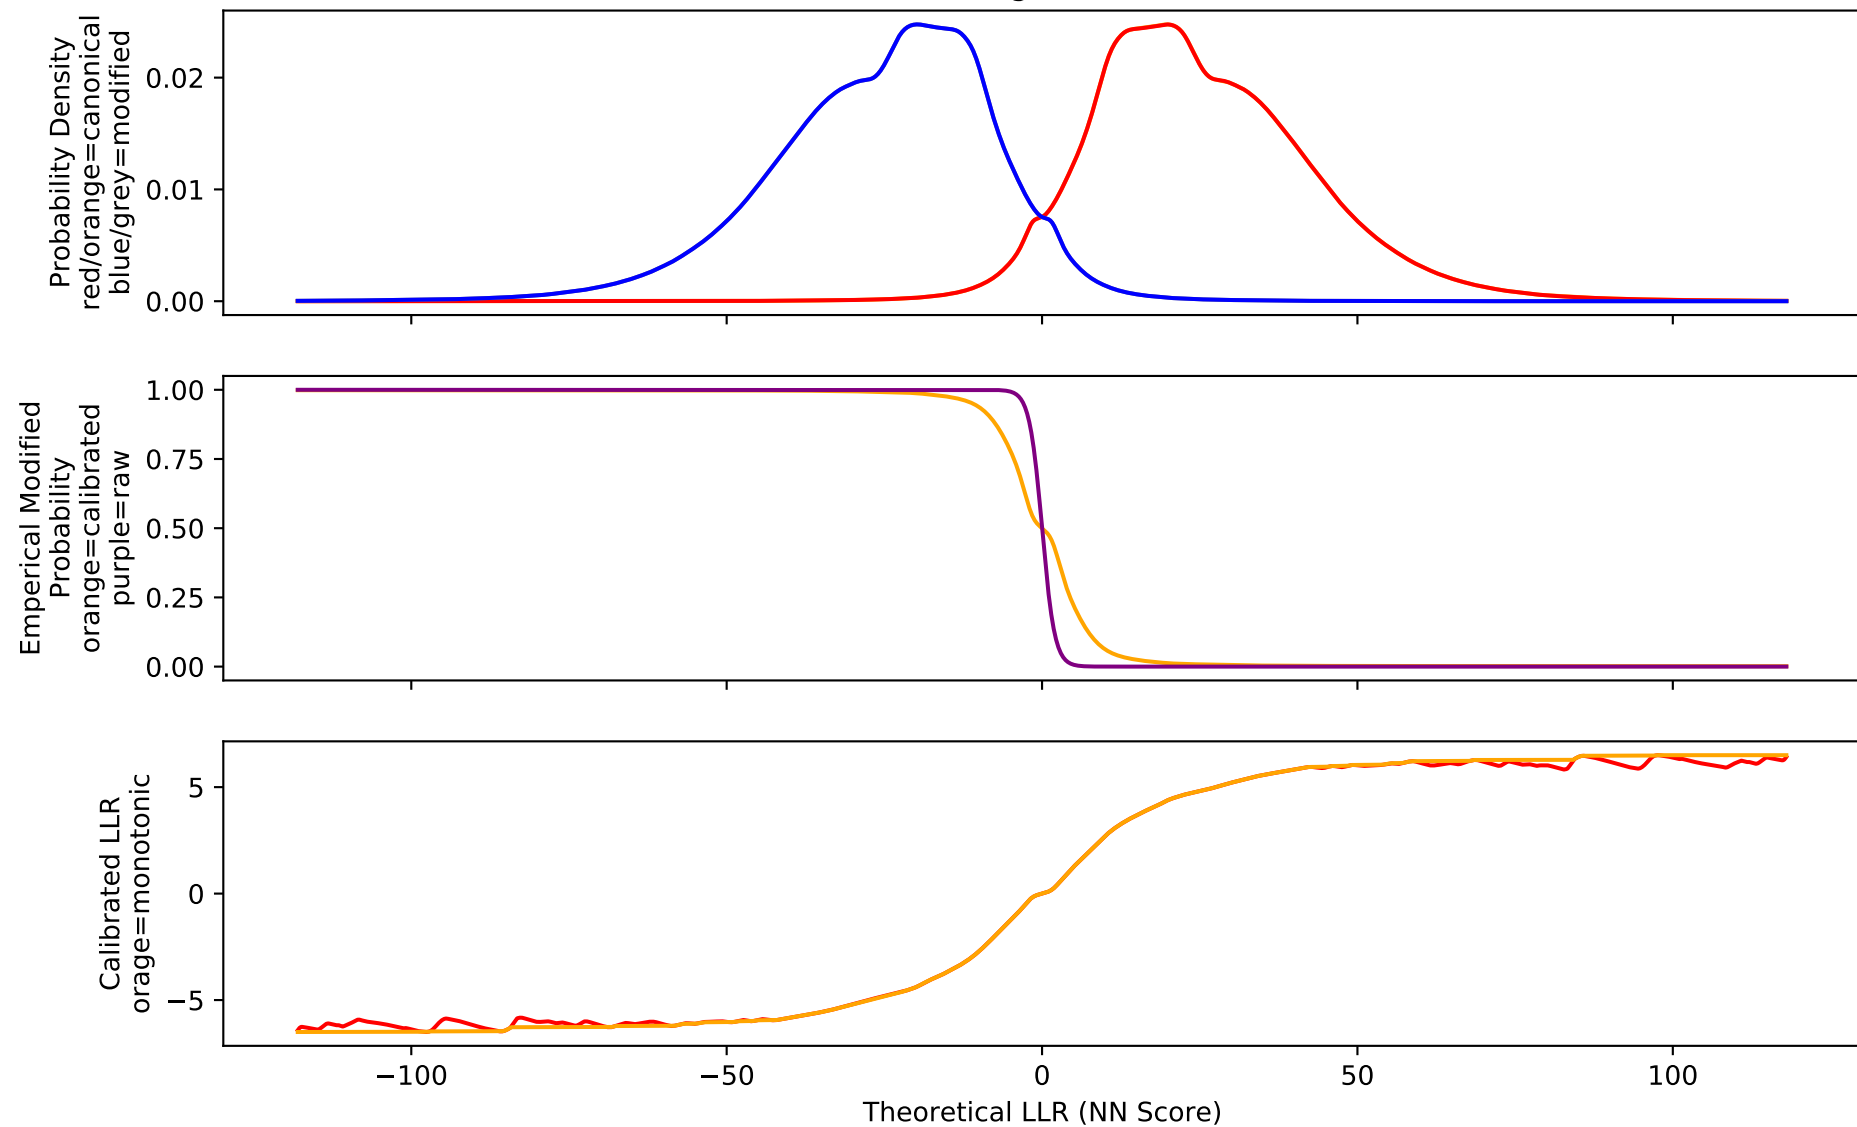


# Deletion Length 3 Calibration

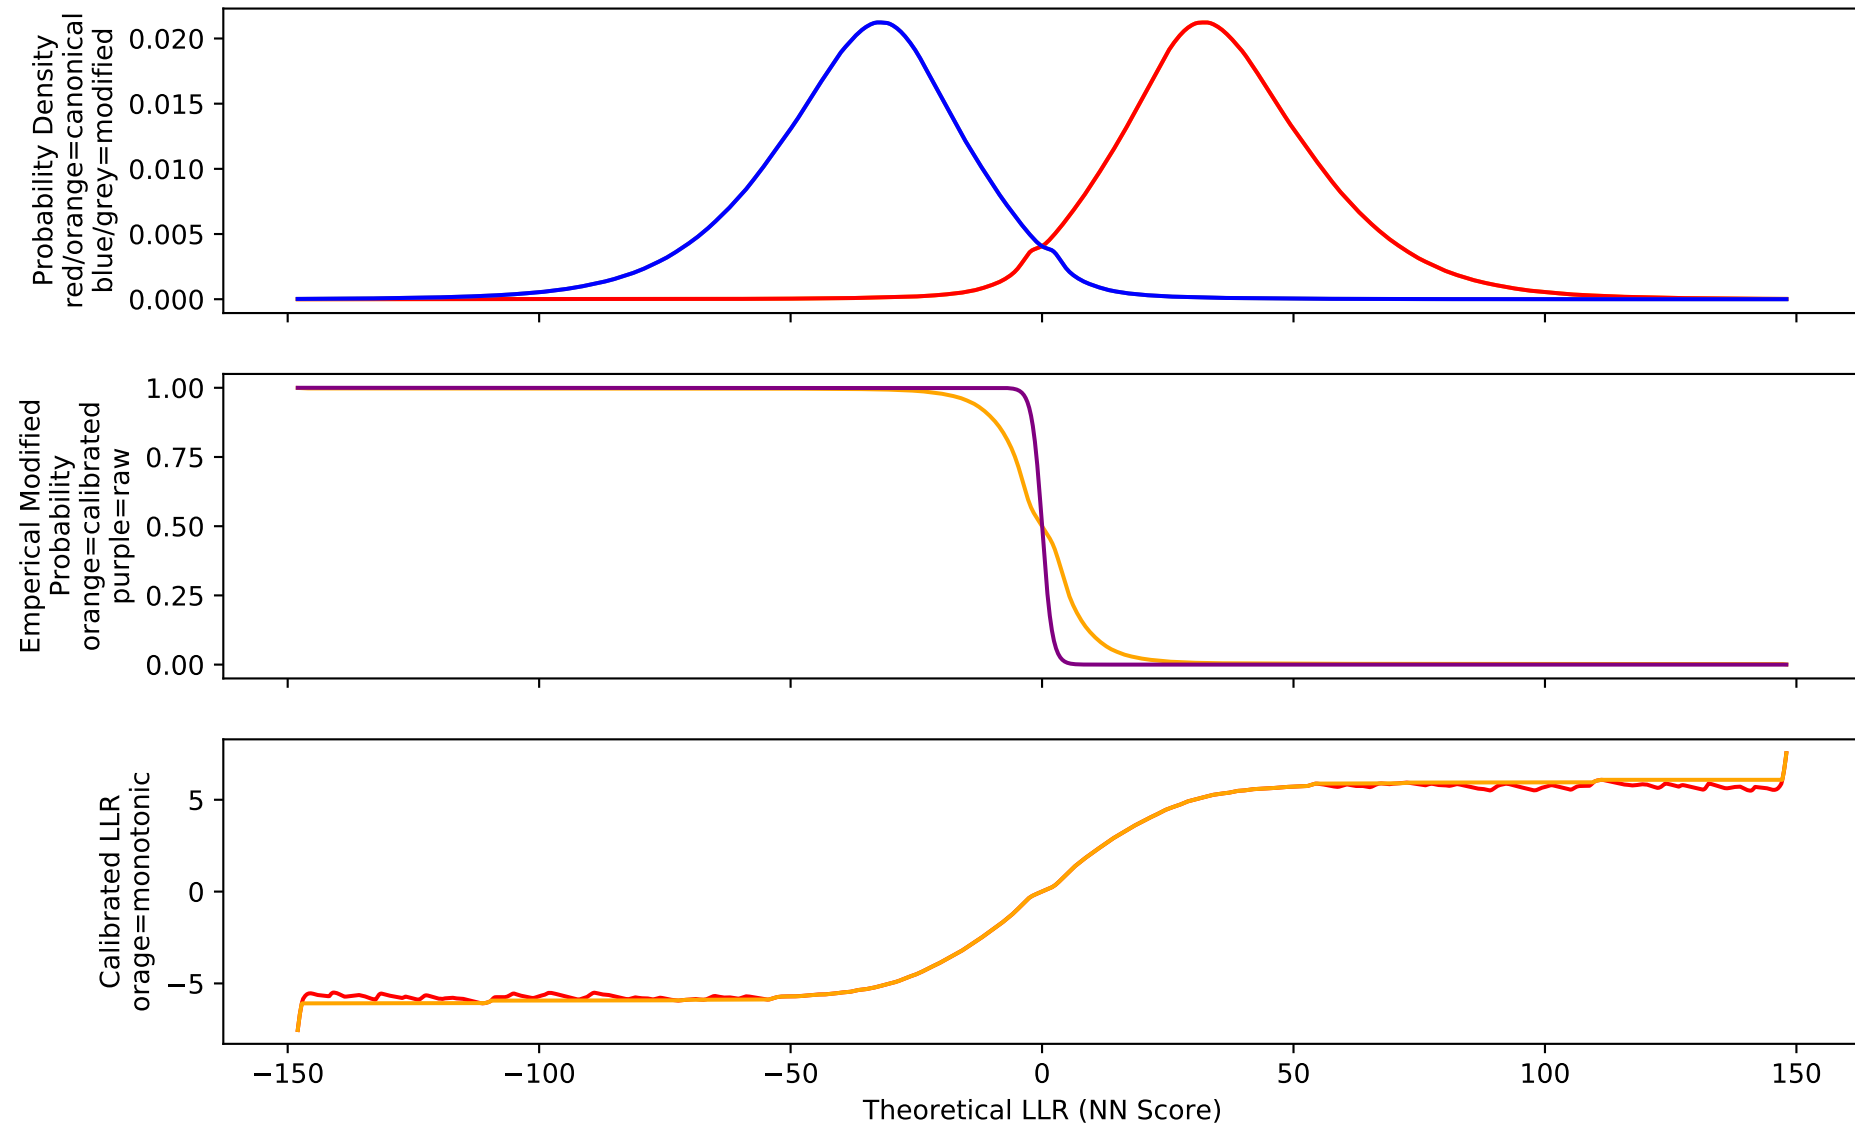





# Deletion Length 4 Calibration

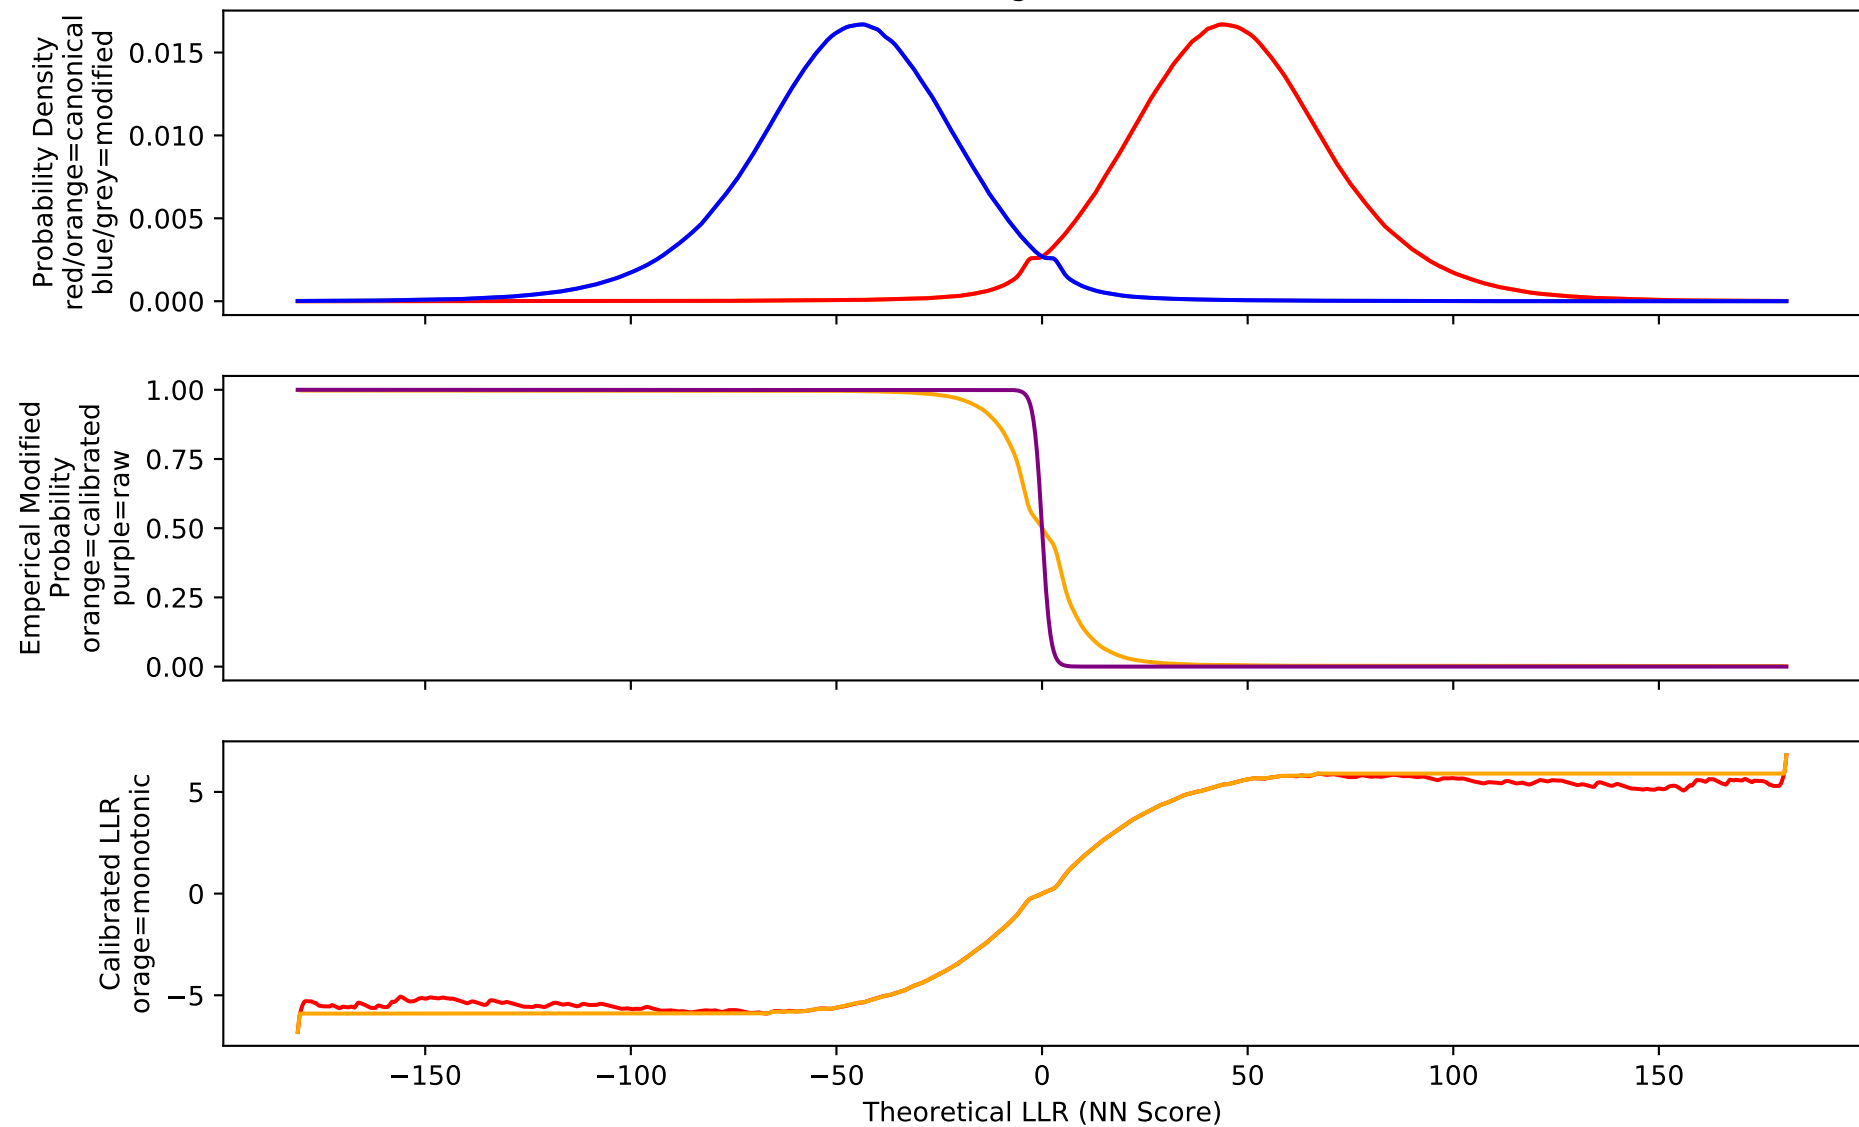


Deletion Length 5 Calibration

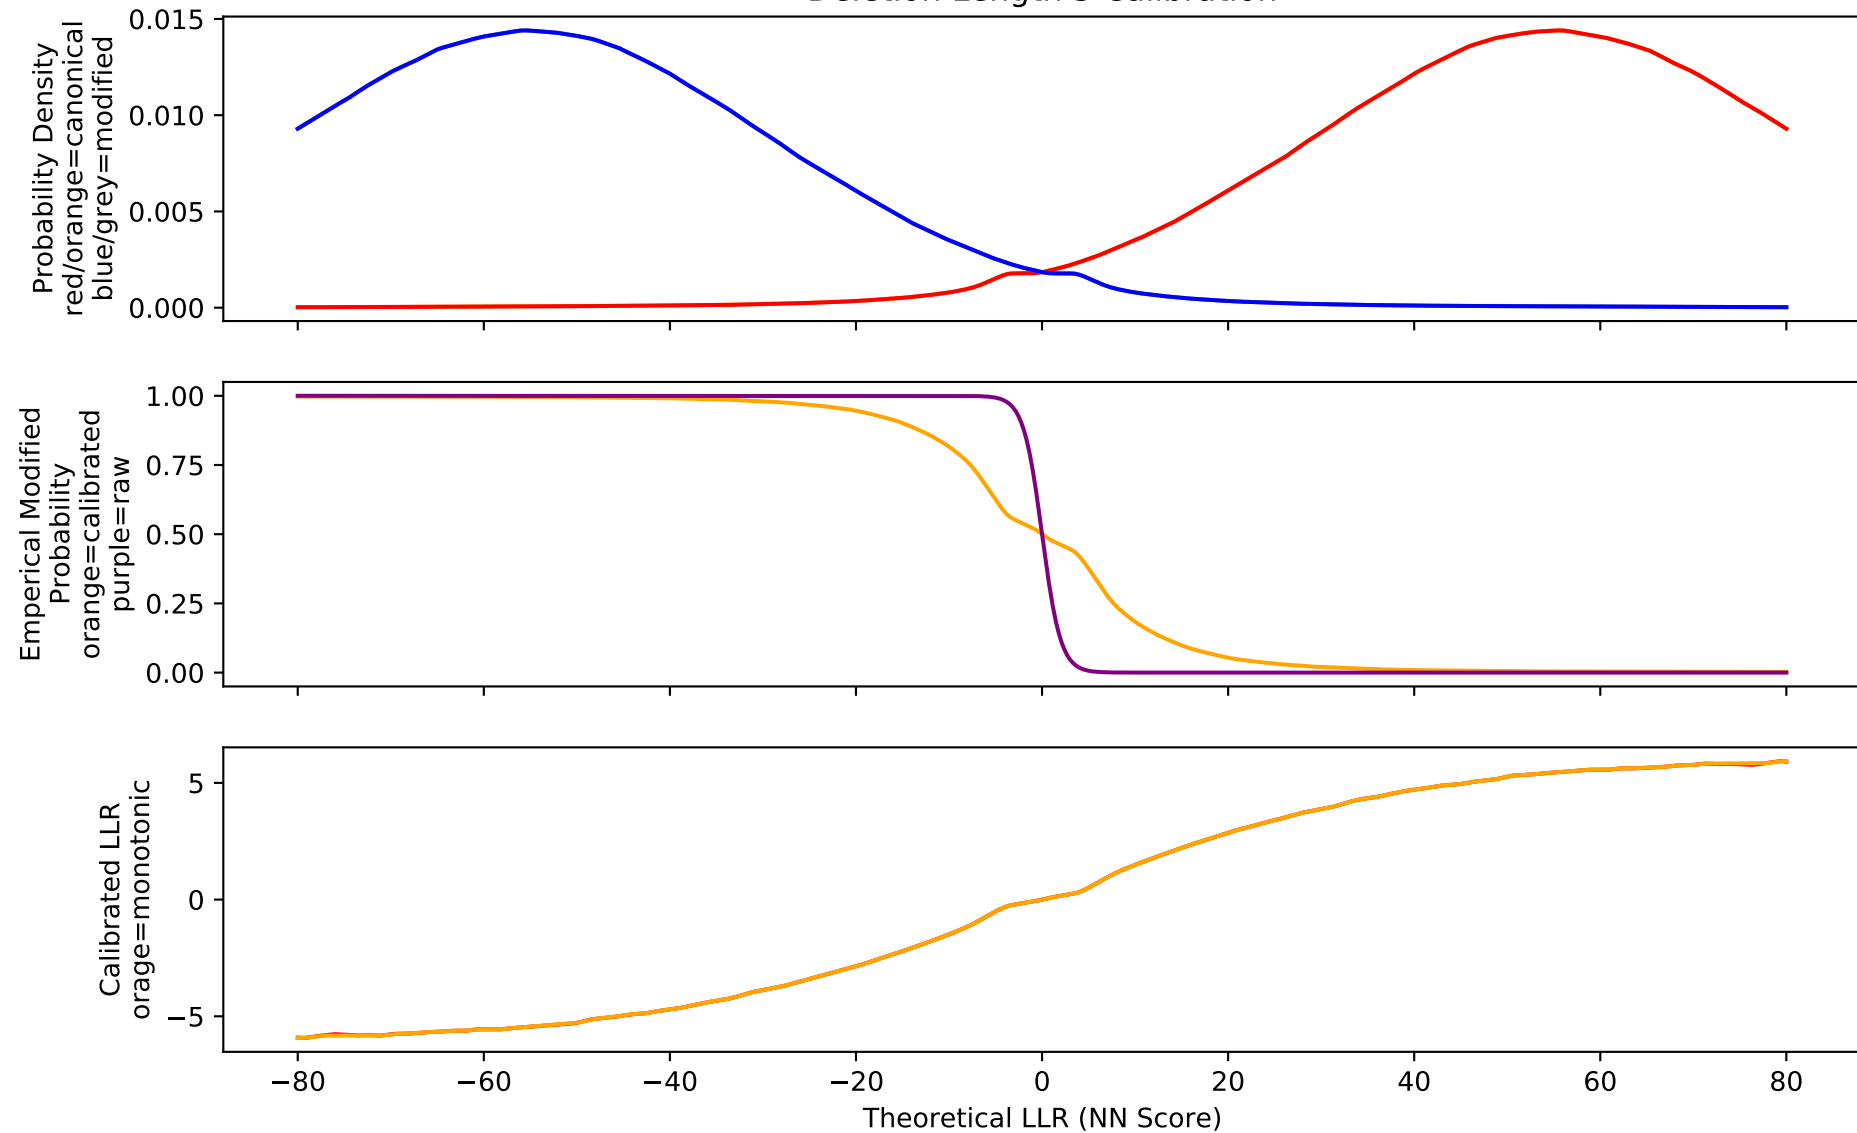


# Insertion Length 1 Calibration

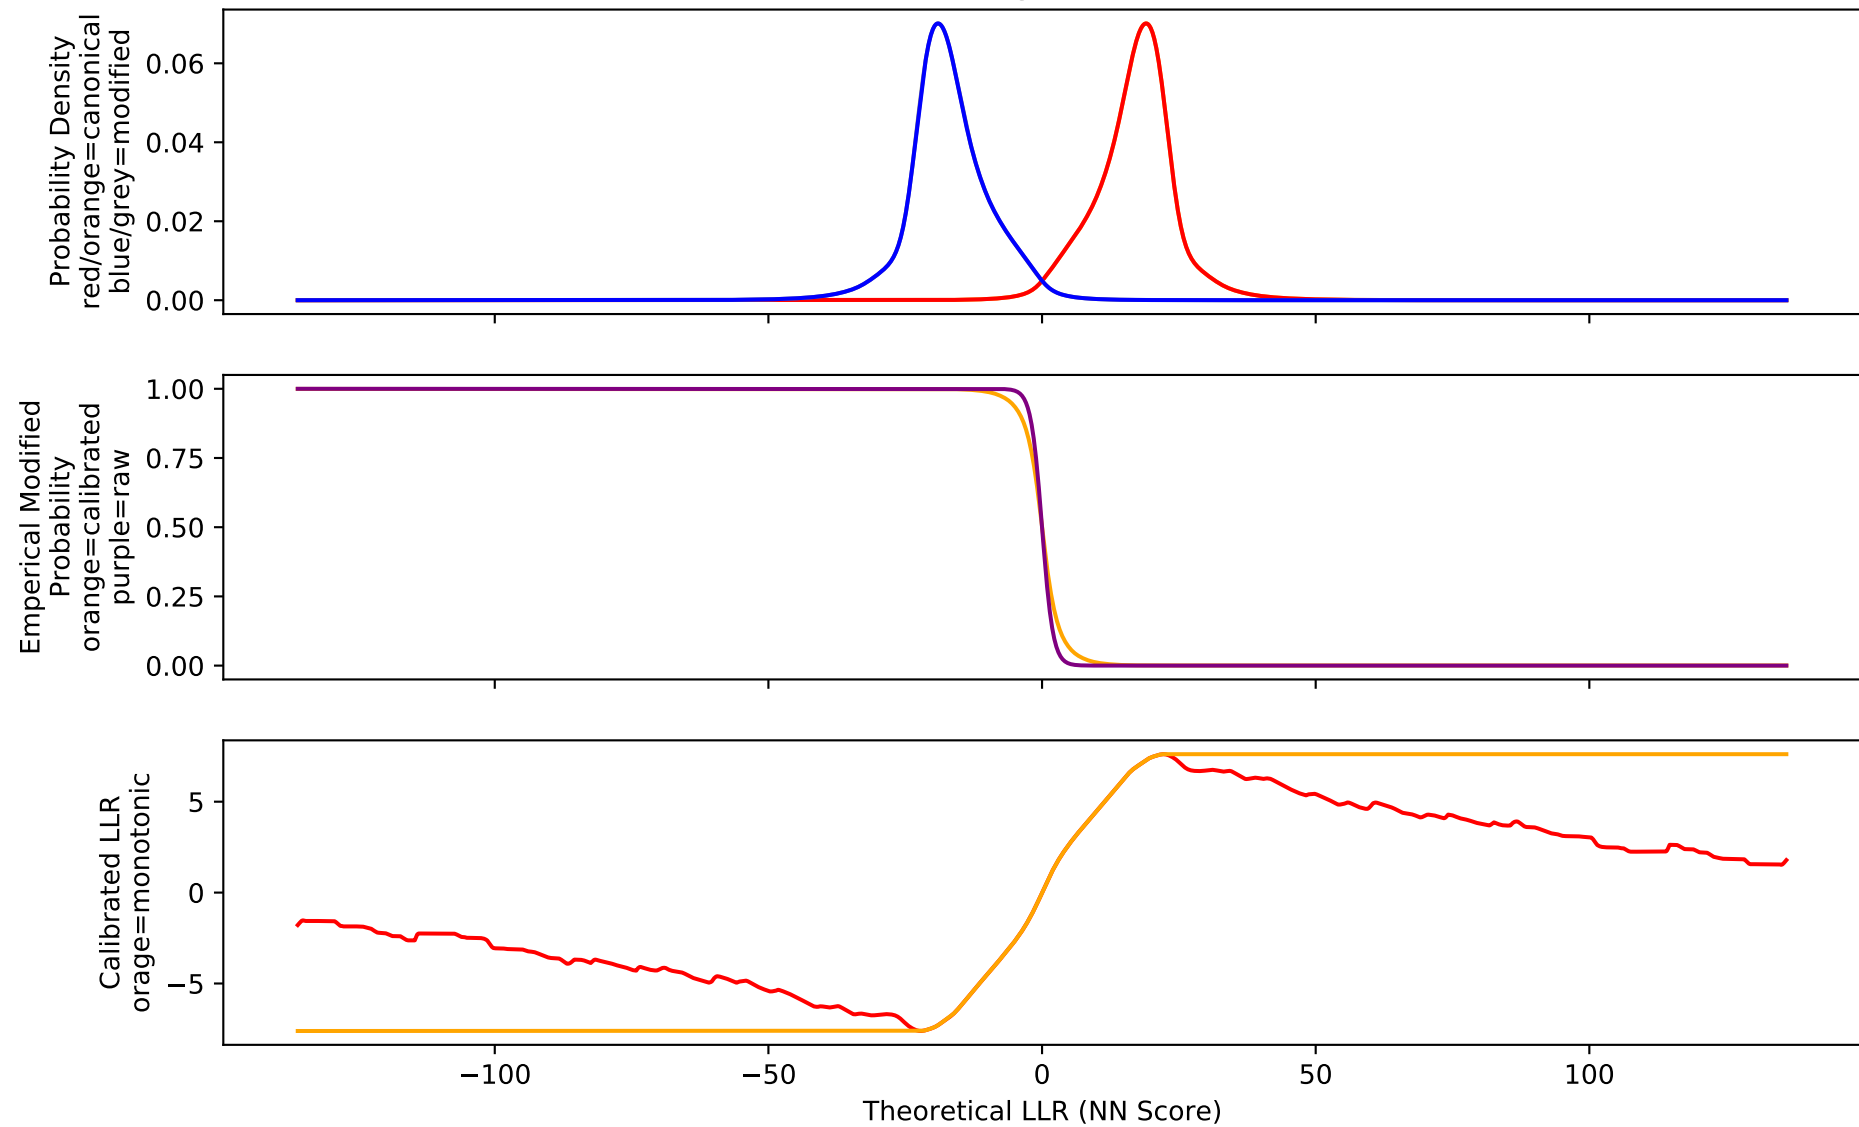


# Insertion Length 2 Calibration

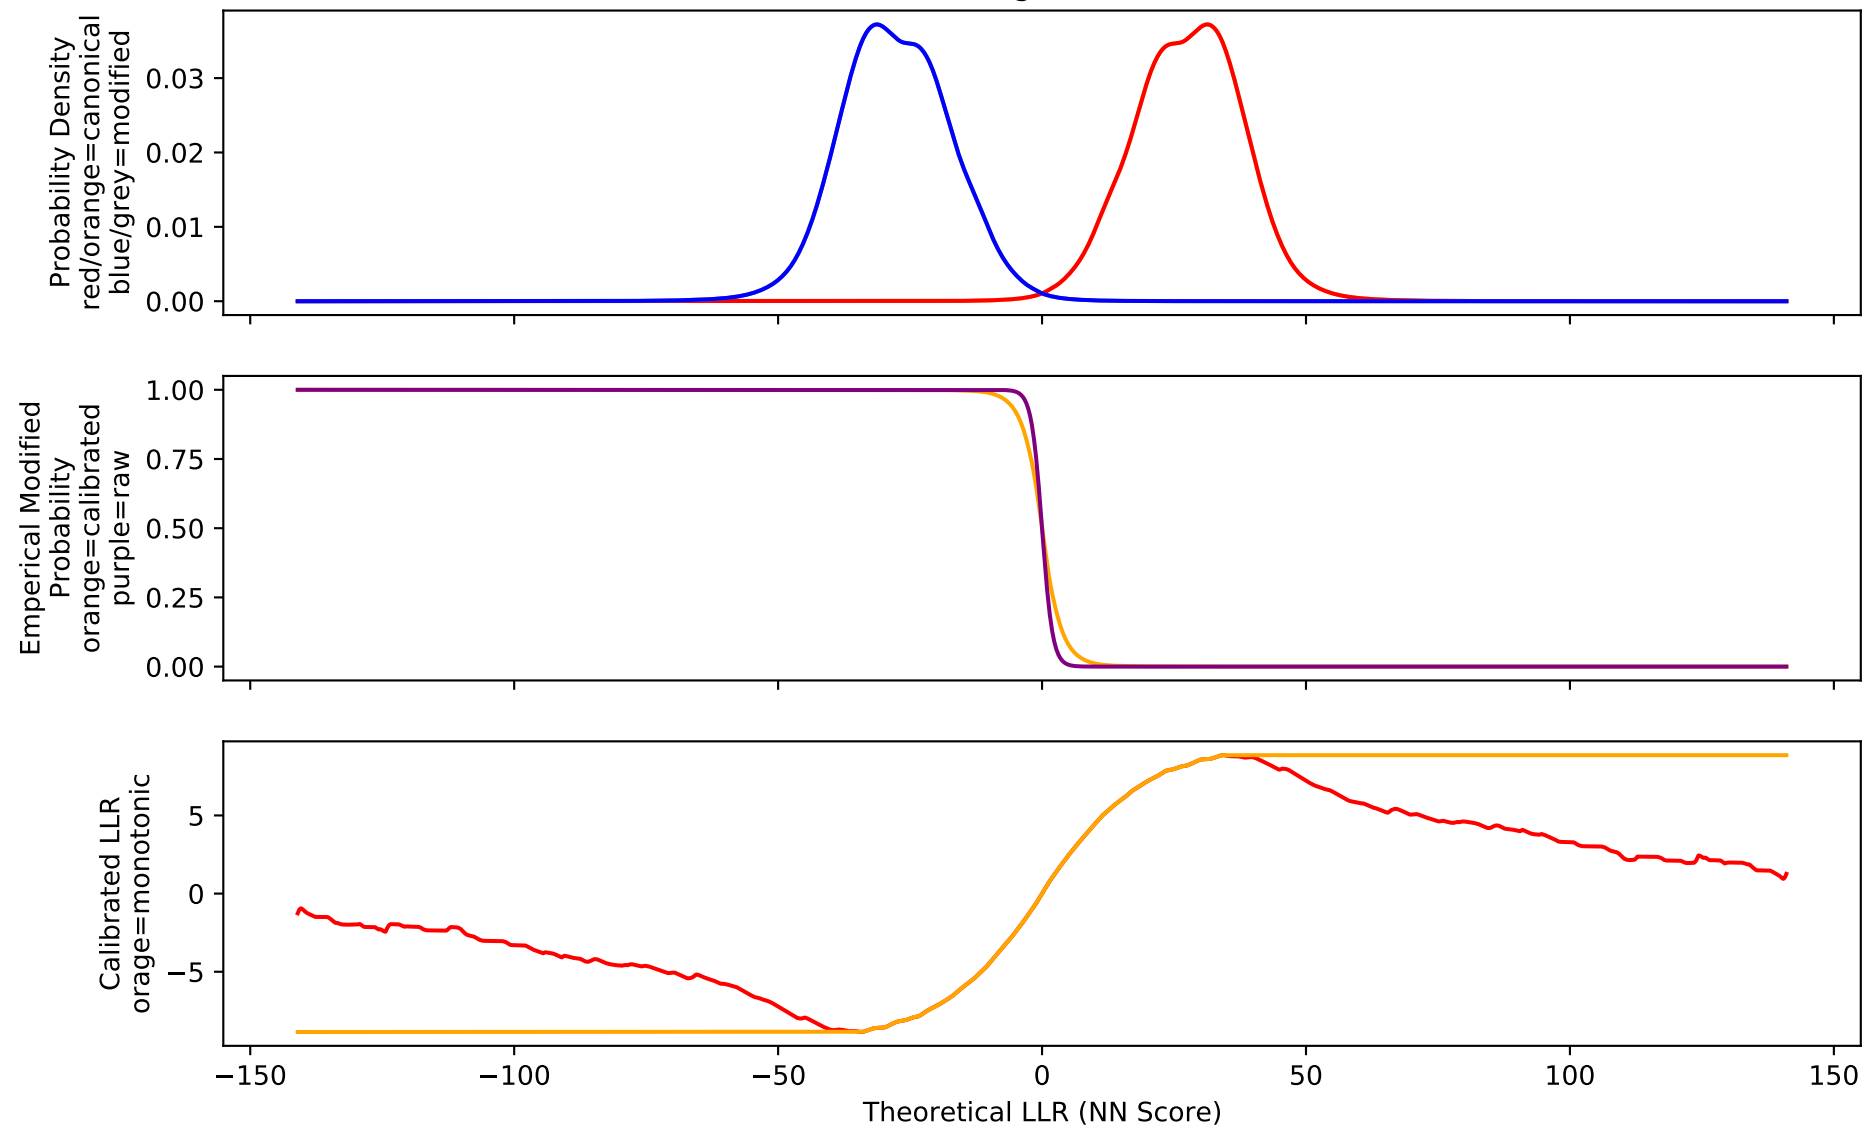

# Insertion Length 3 Calibration

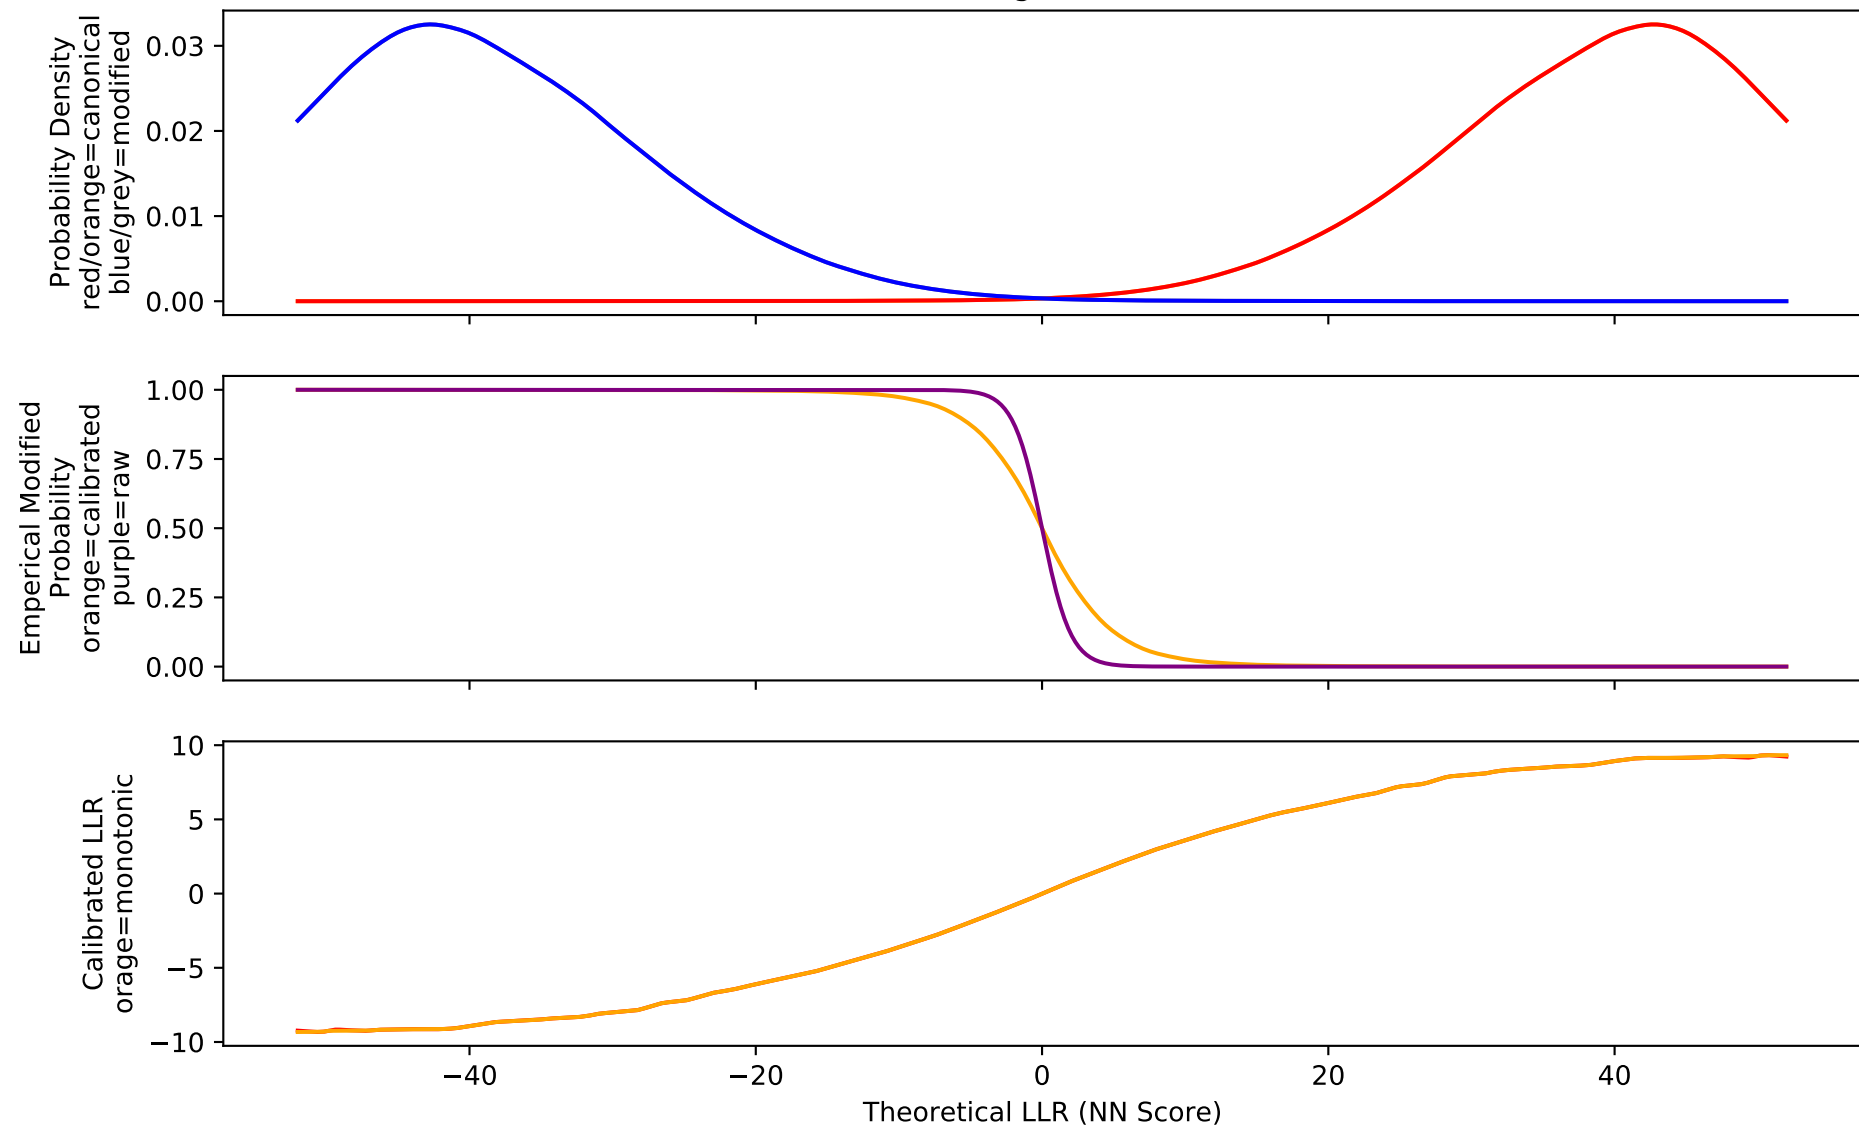

Insertion Length 4 Calibration

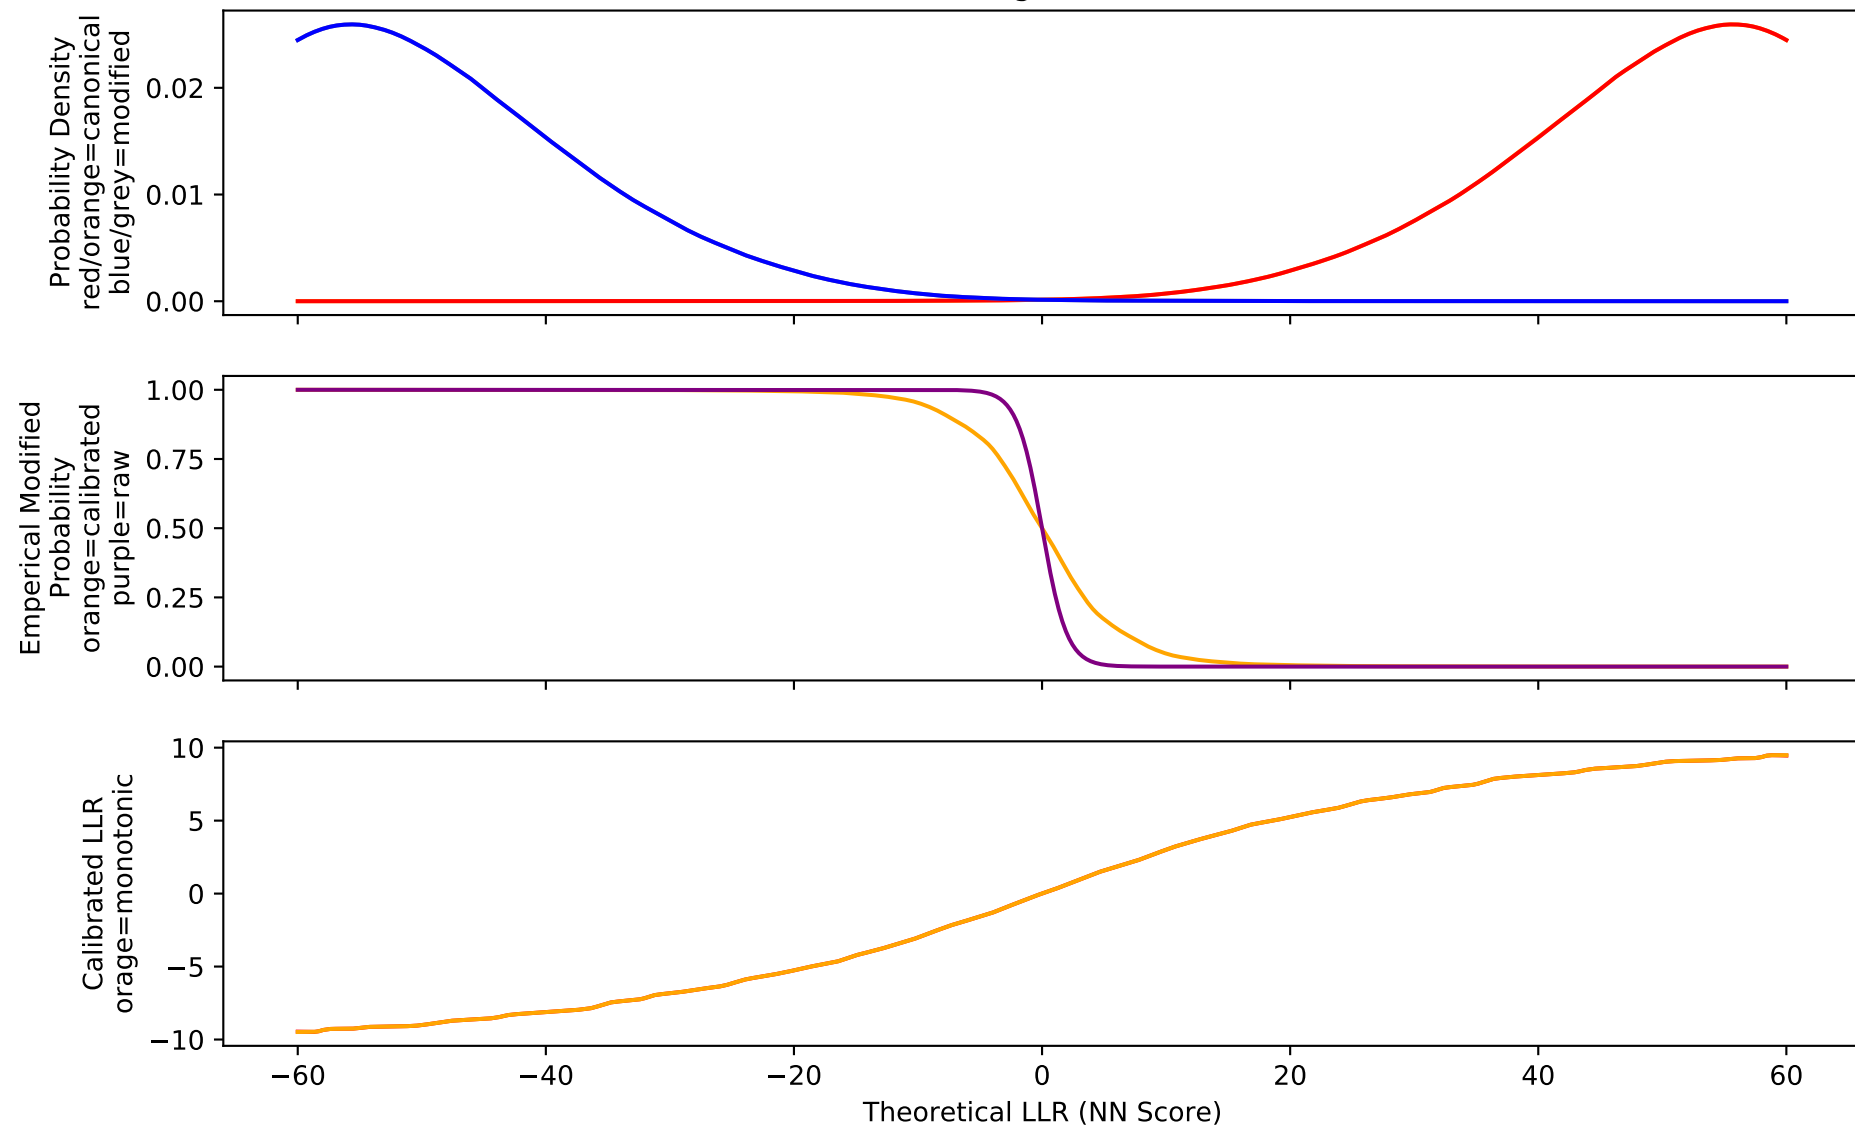

# Insertion Length 5 Calibration

